



NOTES:

1. SPACING FOR SPIDERS TO BE 2 PER 18 FOOT LENGTH OF PIPE, ONE SUPPORT AT EACH END.
2. ENTIRE SPIDER ASSEMBLY TO BE BITUMINOUS COATED AFTER FABRICATION.
3. FIELD MODIFY AS REQUIRED TO PROVIDE DESIGN SLOPE IN CARRIER PIPE.

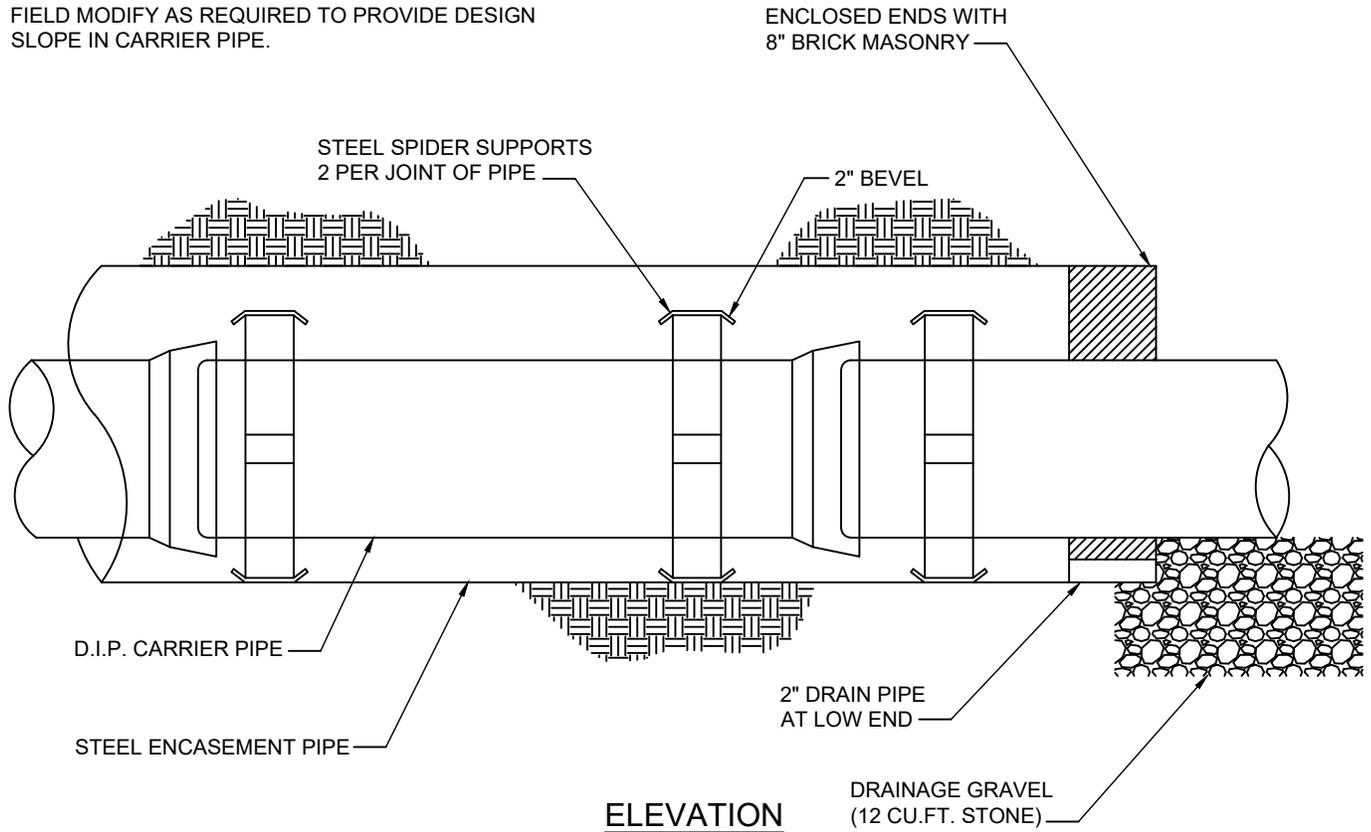

ELEVATION

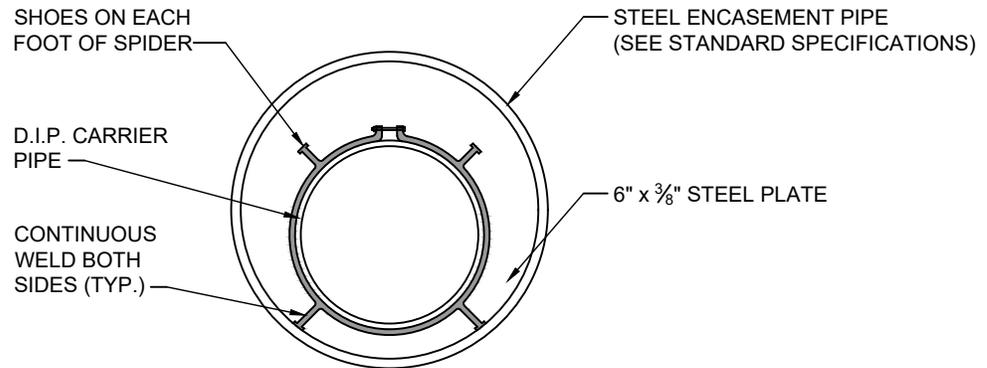

PLAN VIEW



EFFECTIVE: 10/01/16

STEEL CASING PIPE, CARRIER
PIPE AND SPIDERS

NOT TO SCALE

TOWN OF PITTSBORO

STANDARD CONSTRUCTION
DETAIL

STANDARD NO: MU-02-002