


REPLACE ALL PAVING ACCORDING TO SECTION 336

NEW CONSTRUCTION

EXISTING SEWER CONNECTION OR MAIN BROKEN DURING EXCAVATION FOR NEW CONSTRUCTION

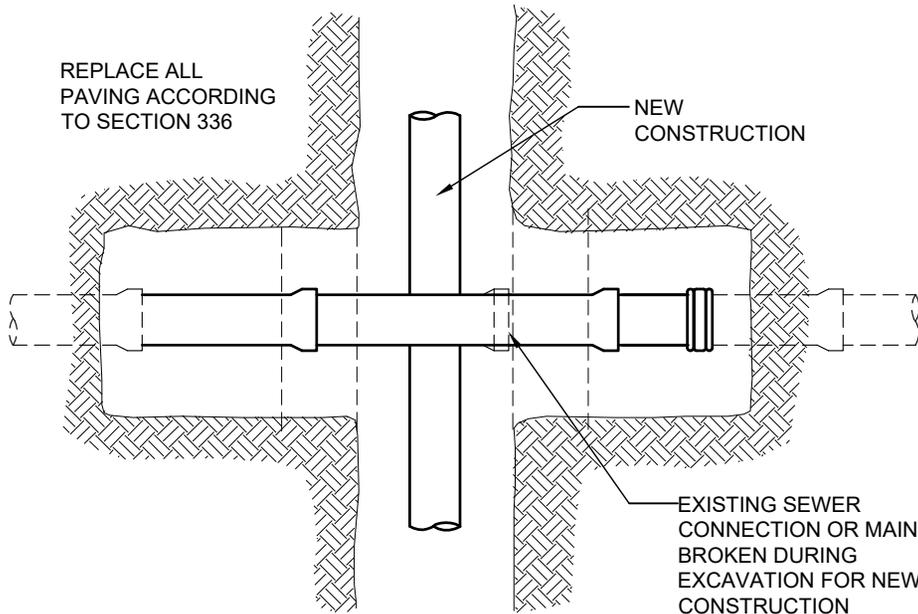


PLAN VIEW OF REPLACEMENT

EXCAVATE 6" BEYOND UNBROKEN BELL TO ALLOW ROOM FOR INSPECTION

18" MIN. WHEN USING BELL CONNECTION


COMPACTION SHALL BE DONE IN ACCORDANCE WITH SECT. 601

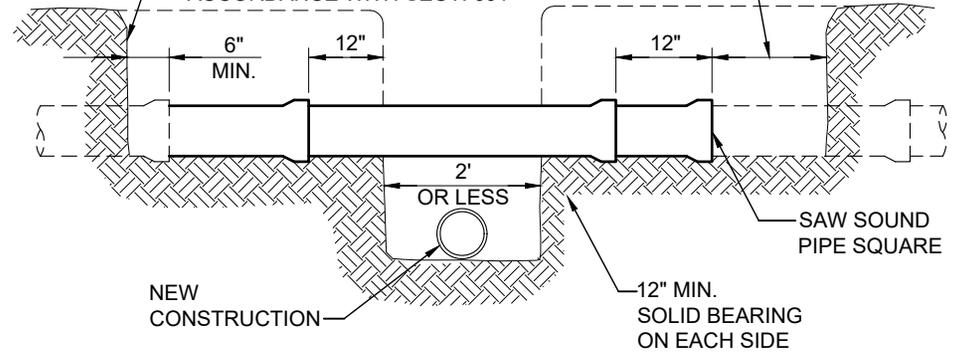

REPLACEMENT WHEN NEW TRENCH 2' WIDE OR LESS


COMPACTION SHALL BE DONE IN ACCORDANCE WITH SECT. 601

6" MIN. WHEN USING CAULDER CONNECTION

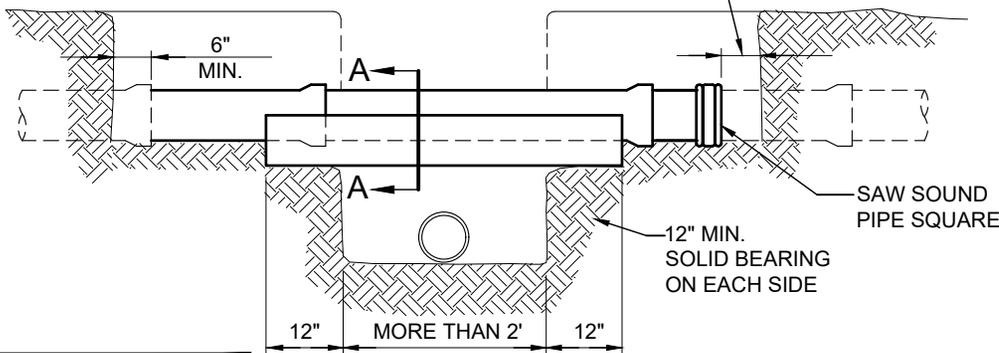

REPLACEMENT WHEN NEW TRENCH MORE THAN 2' WIDE

REBAR TO BE NO. 4 WITH MAX. OF 6" BETWEEN & MIN. OF 3 BARS

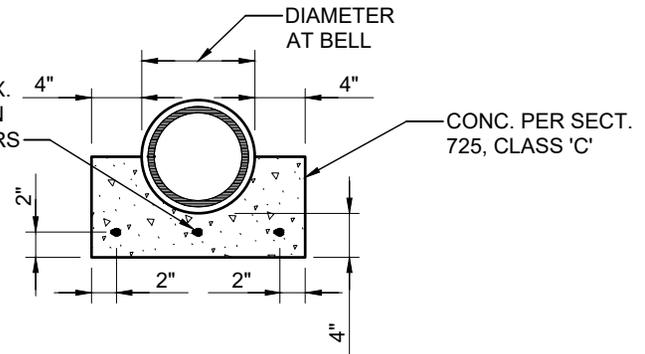

SECTION 'A-A'

NOTES:

1. BROKEN PIPE SHALL BE REPLACED WITH A MINIMUM OF ONE FULL JOINT AND TWO SHORT LENGTHS WITH UNBROKEN BELLS.



EFFECTIVE: 10/01/16

BROKEN SEWER LINE REPLACEMENT

TOWN OF PITTSBORO

STANDARD CONSTRUCTION
DETAIL

STANDARD NO: MU-02-006.00