







PIPE SIZE	A	B	C	D
4"	12-1/2"	10-1/8"	2-1/2"	1-3/4"
6"	14-1/2"	12-1/8"	3-9/16"	2-13/16"
8"	16-3/4"	14-3/8"	4-21/32"	3-29/32"
10"	19-1/16"	16-11/16"	5-3/4"	5"
12"	22-5/16"	19-3/16"	6-3/4"	5-7/8"



RODS ARE ATTACHED TO LUGS CAST ON BELL OF HYDRANT. IF HYDRANT IS NOT FITTED WITH LUGS, RODS ARE ATTACHED AS SHOWN BY THE DOTTED LINES.

HYDRANT ANCHOR

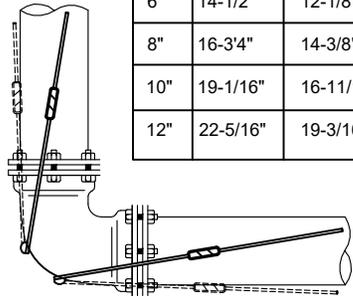

EFFECTIVE: 10/01/16

JOINT RESTRAINT WITH TIE RODS

TOWN OF PITTSBORO
 STANDARD CONSTRUCTION
 DETAIL
 STANDARD NO: MU-02-010.01