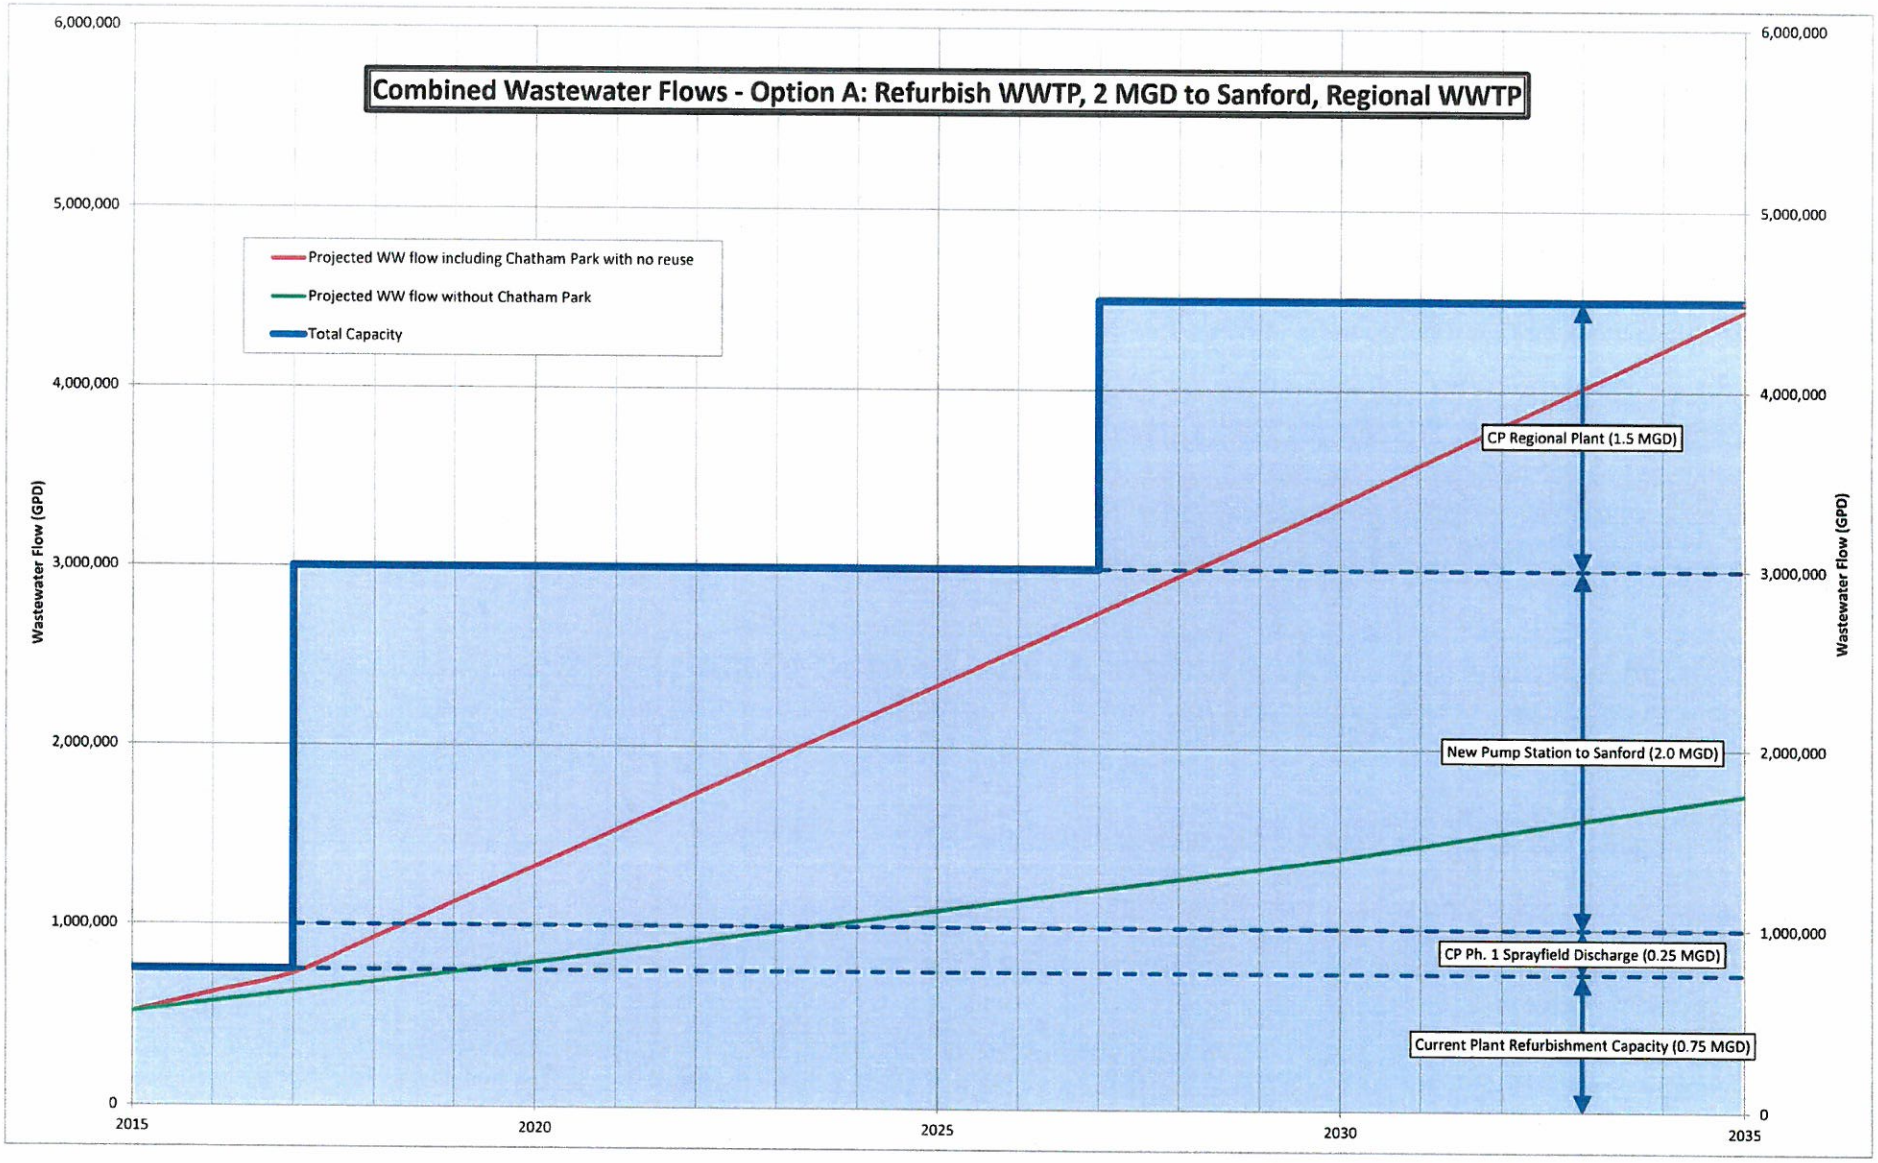
Combined Wastewater Flows - Option A: Refurbish WWTP, 2 MGD to Sanford, Regional WWTP
Projected WW flow including Chatham Park with no reuse
Projected WW flow without Chatham Park
Total Capacity
CP Regional Plant (1.5 MGD)
New Pump Station to Sanford (2.0 MGD)
CP Ph. 1 Sprayfield Discharge (0.25 MGD)
Current Plant Refurbishment Capacity (0.75 MGD)
Wastewater Flow (GPD)
6,000,000
5,000,000
4,000,000
3,000,000
2,000,000
1,000,000
0
2015
2020
2025
2030
2035