


FIRE HYDRANT SHALL BE
MUELLER, CENTURION

NOTE:
HYDRANTS TO BE SET AT EDGE OF RW
AND AT PROPERTY/STREET CORNERS
UNLESS OTHERWISE ALLOWED.

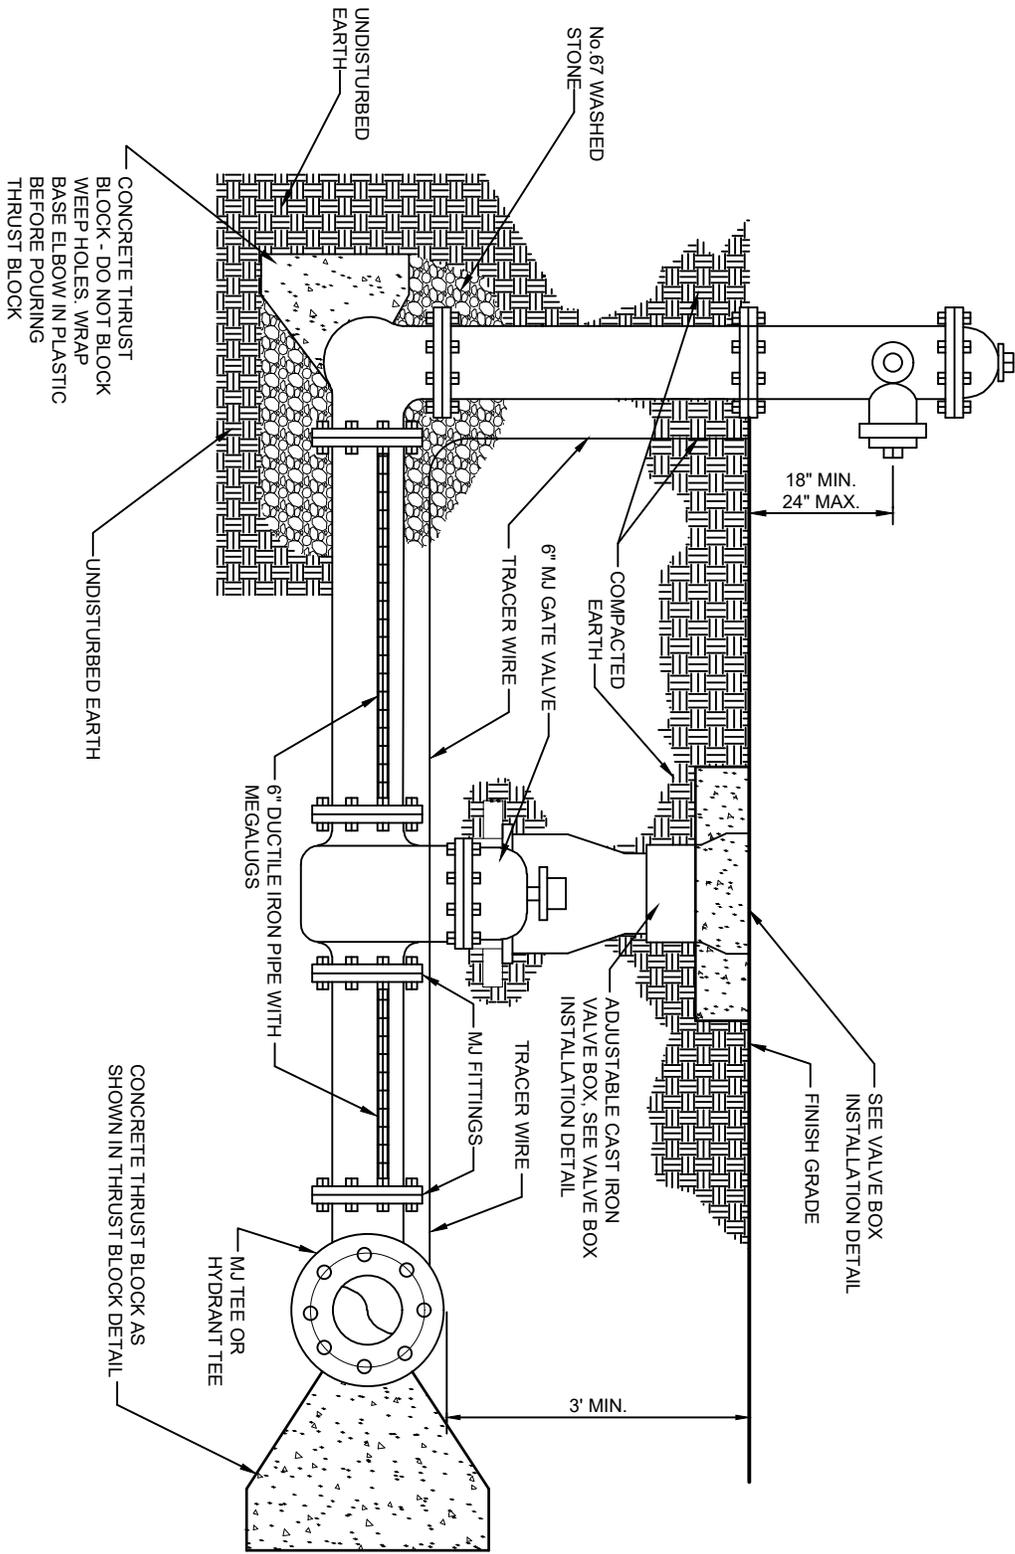

TOWN OF PITTSBORO
STANDARD CONSTRUCTION
DETAIL
STANDARD NO: PW-03-010

STANDARD FIRE HYDRANT

