Smoke Test Defect Location Map

Town of Pittsboro, NC

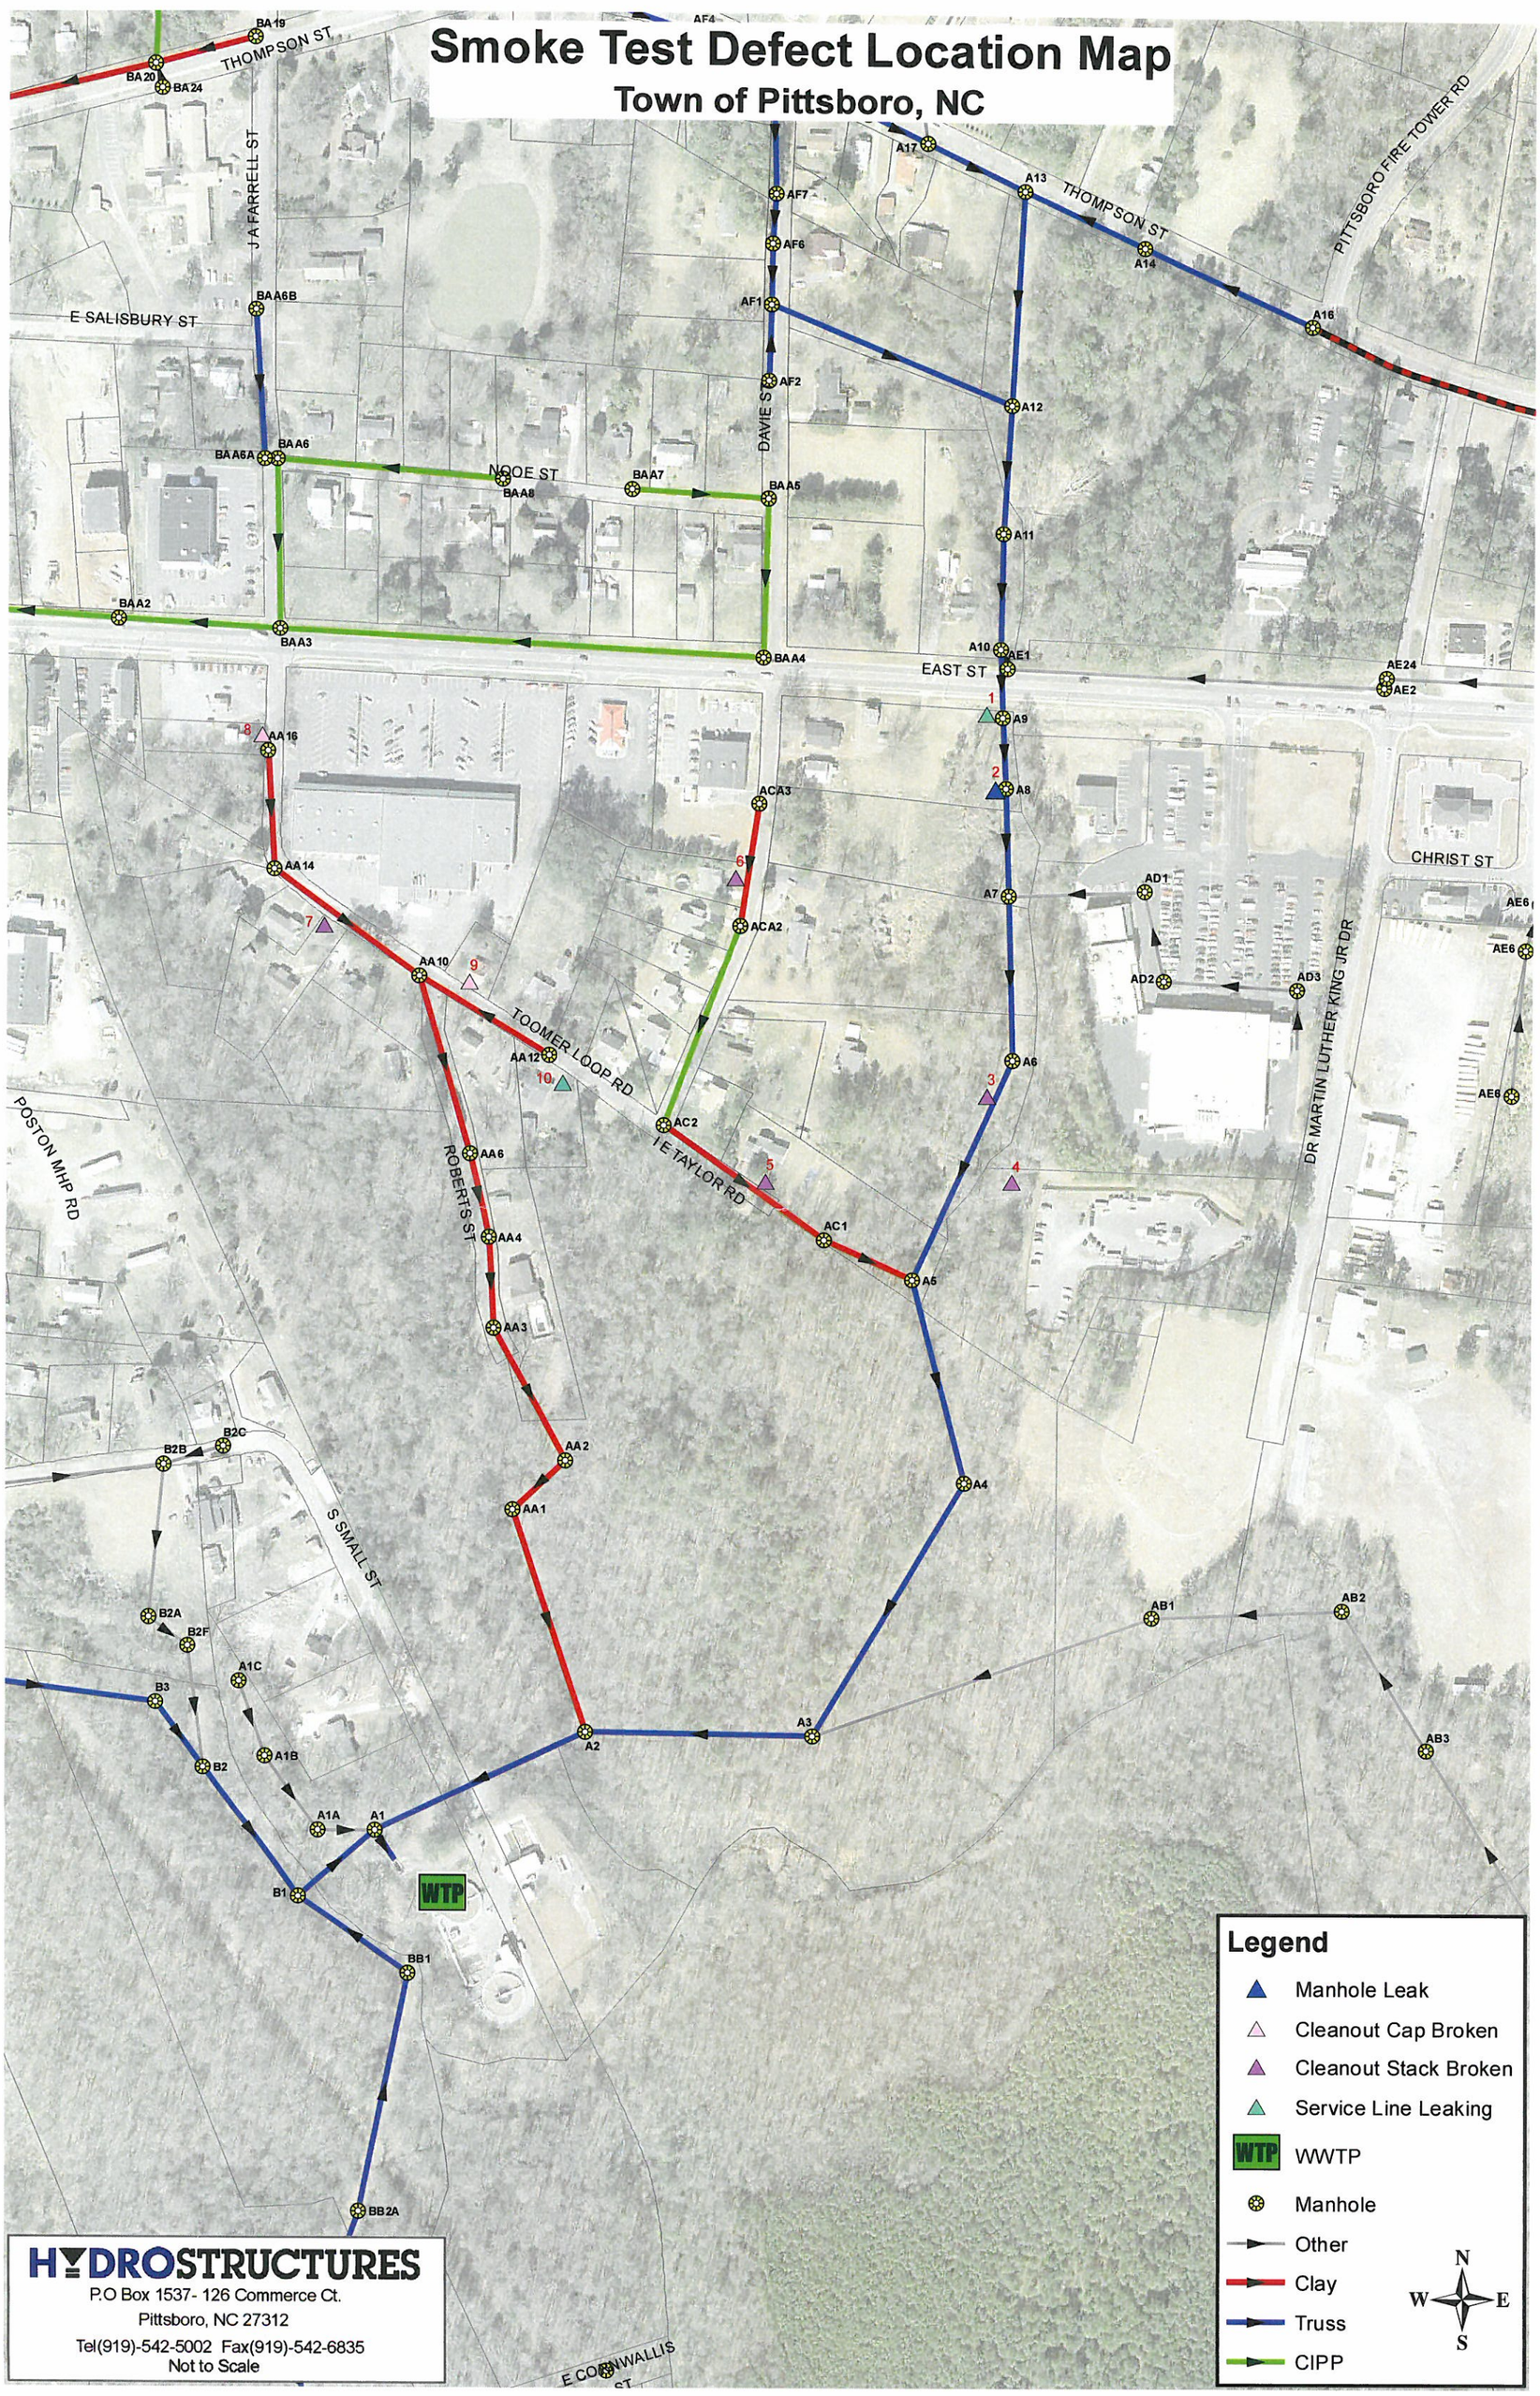

Legend

- Manhole Leak
- Cleanout Cap Broken
- Cleanout Stack Broken
- Service Line Leaking
- WWTP
- Manhole
- Other
- Clay
- Truss
- CIPP

N W E S

HYDROSTRUCTURES

P.O Box 1537- 126 Commerce Ct.
Pittsboro, NC 27312
Tel(919)-542-5002 Fax(919)-542-6835

Not to Scale