



SCENARIO 1
RECLAIMED SERVICE CONNECTION (NEW INSTALLATION)

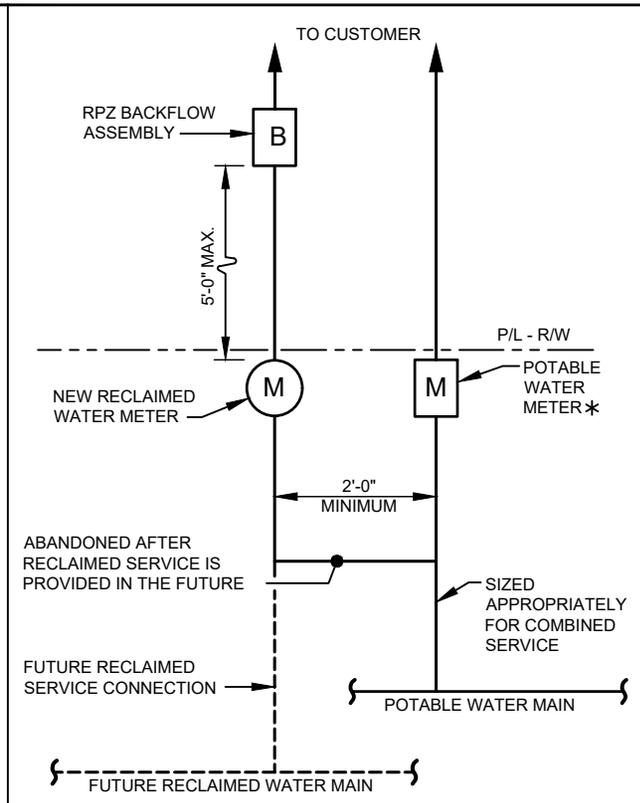

SCENARIO 2
PRESENT POTABLE IRRIGATION CONNECTION WHERE RECLAIMED SERVICE IS NOT YET AVAILABLE

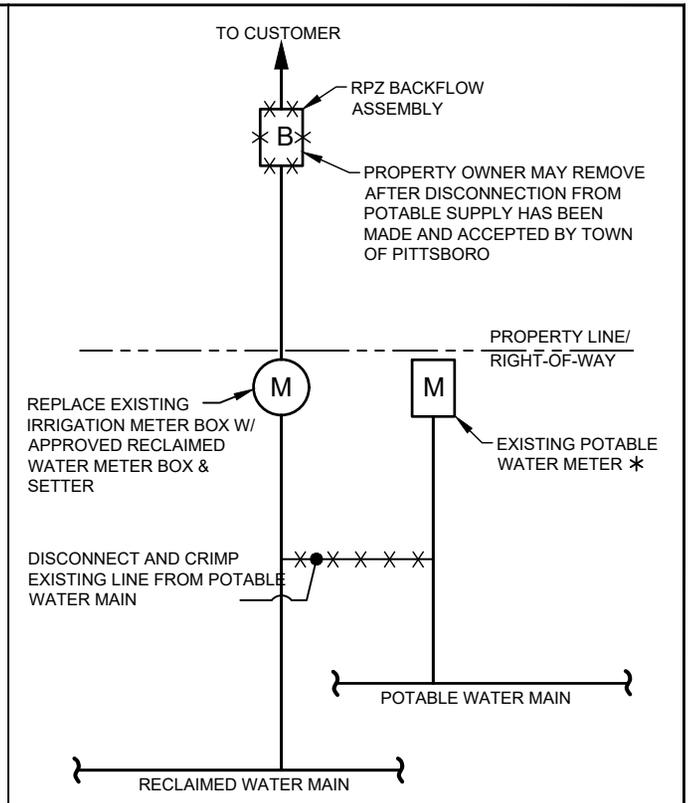

SCENARIO 3
RETROFIT OF EXISTING IRRIGATION METER ASSEMBLY FROM POTABLE TO RECLAIMED SERVICE

- *NOTES:**
1. POTABLE WATER METER SHALL BE FITTED WITH DUAL CARTRIDGE CHECK VALVE.
 2. METERS ARE TO BE PLACED IMMEDIATELY INSIDE OF R/W OR UTILITY EASEMENT LINE.
 3. ALL PIPE AND APPURTENANCES LOCATED OUTSIDE OF THE RIGHT-OF-WAY OR EASEMENT ARE MAINTAINED BY THE PROPERTY OWNER.



EFFECTIVE: 10/01/16

**STANDARD RECLAIMED WATER SERVICE CONNECTIONS
 IN DEFINED RECLAIMED SERVICE AREAS**

TOWN OF PITTSBORO
 STANDARD CONSTRUCTION
 DETAIL
 STANDARD NO: RW-06-001