



SIDE VIEW



LID TOP VIEW

STANDARD HEAVY DUTY METER BOX

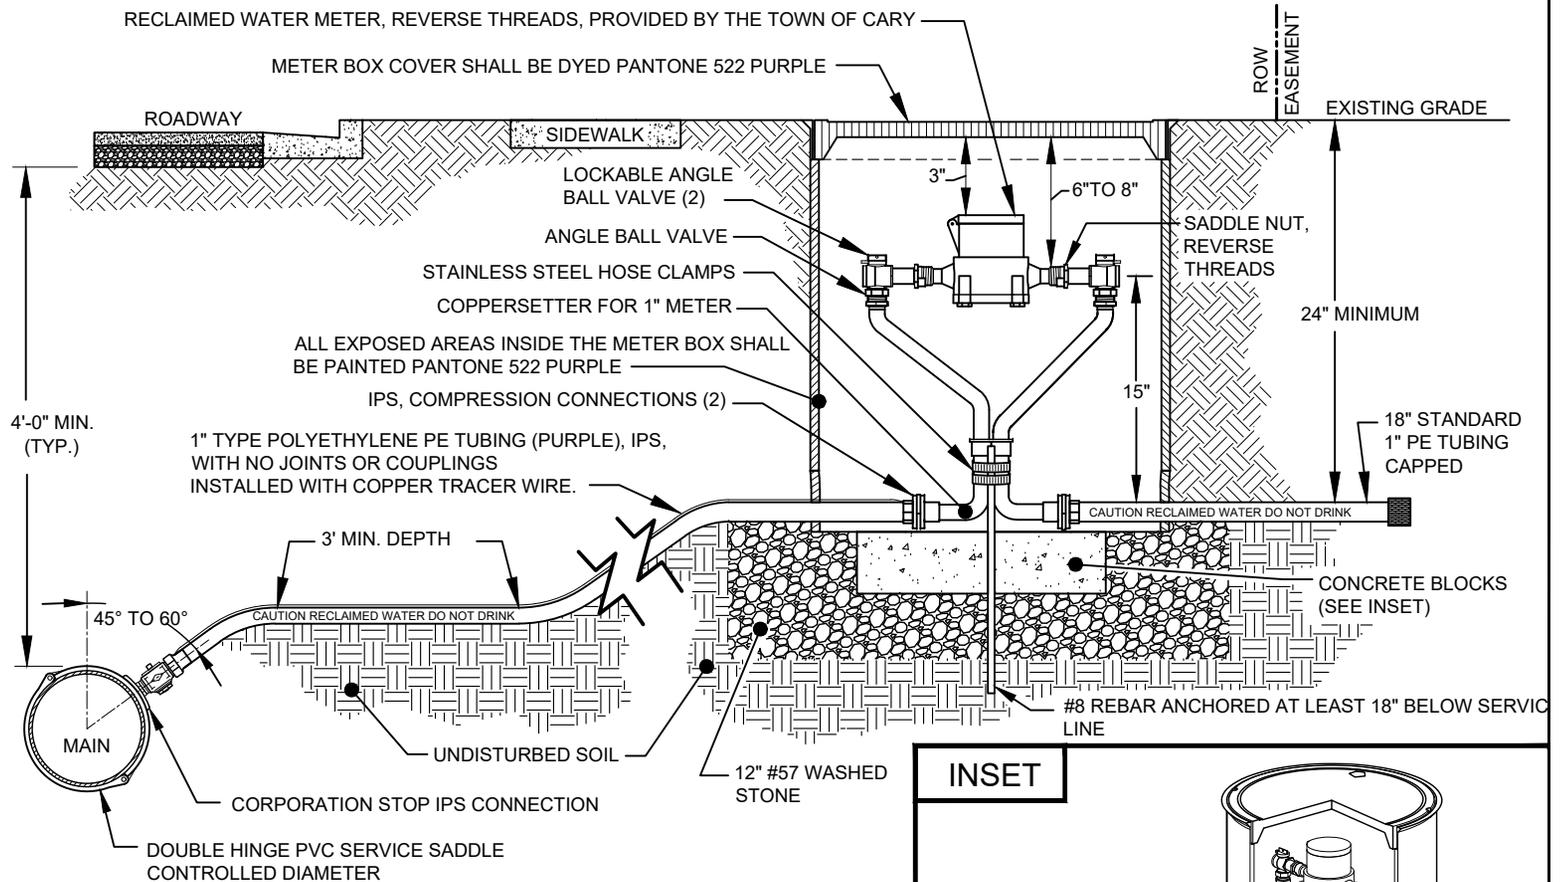


NOTES:

- 1) WATER METER SHALL NOT BE LOCATED IN AREAS SUBJECT TO VEHICULAR TRAFFIC.
- 2) ALL METER BOXES SHALL BE AS MANUFACTURED BY CDR WITH HEAVY DUTY RATED LOCKING POLYMER CEMENT COVER AS APPROVED BY THE TOWN.
- 3) ALL SERVICE LINES, VALVES AND FITTINGS SHALL COMPLY WITH AWWA C800.
- 4) METER & SETTER SHALL BE INSTALLED AND ANCHORED IN CENTER OF BOX.
- 5) THE INTERIOR OF THE BOX SHALL BE STENCILED WITH THE WORDS, **CAUTION RECLAIMED WATER - DO NOT DRINK.**
- 6) ALL RELOCATIONS OF EXISTING OR PERMITTED RECLAIMED WATER INFRASTRUCTURE INCLUDING SERVICE PIPING AND METER BOXES SHALL BE PERMITTED AND INSPECTED IN CONFORMANCE WITH TOWN POLICIES AND PROCEDURES.

INSET

SET BOX ON ONE ROW OF 4"x8"x16" SOLID CONCRETE BLOCKS

BOX OVERLAPS BLOCKS BY ONE INCH

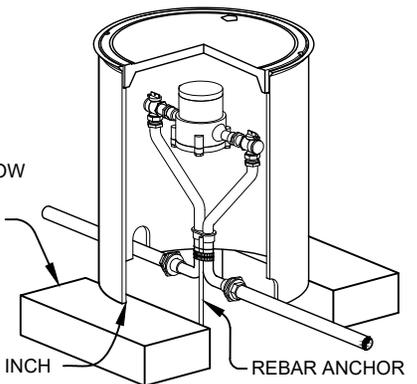

EFFECTIVE: 10/01/16

STANDARD 1" RECLAIMED WATER SERVICE & METER BOX INSTALLATION

TOWN OF PITTSBORO

STANDARD CONSTRUCTION DETAIL

STANDARD NO: RW-06-002