


- NOTES:**
- 1) CUSTOM SETTER PIPING TO BE NO LEAD BRASS & COPPER TUBING AND SHALL BE EQUIPPED W/ANGLED CHECK VALVE OUTLETS & BY-PASS FLANGED VALVE OR BY-PASS FLANGED BALL VALVE INLETS.
 - 2) PRECAST CONCRETE BOX WITH ALUMINUM ACCESS HATCH WILL BE AN ACCEPTABLE ALTERNATIVE WITH APPROVAL OF THE DIRECTOR OF ENGINEERING.
 - 3) THE INTERIOR OF THE BOX SHALL BE STENCILED WITH THE WORDS, **CAUTION RECLAIMED WATER - DO NOT DRINK.**
 - 4) METER BOX LID SHALL BE SECURED TO METER YOLK WITH CABLE TETHER.
 - 5) LOCATE METER REGISTER 5 TO 8 INCHES BELOW COVER.
 - 6) ALL BRASS COMPONENTS SHALL BE 'NO LEAD' BRASS MEETING UNS C89833 AS PER ASTM B584.

NOTE:
TO ENSURE POSITIVE DRAINAGE, THE VAULT SHALL HAVE AN OPEN BOTTOM TO ALLOW DRAINAGE THROUGH STONE.

DIMENSIONS (INCHES)

A	B
18 3/8"	30 1/8"

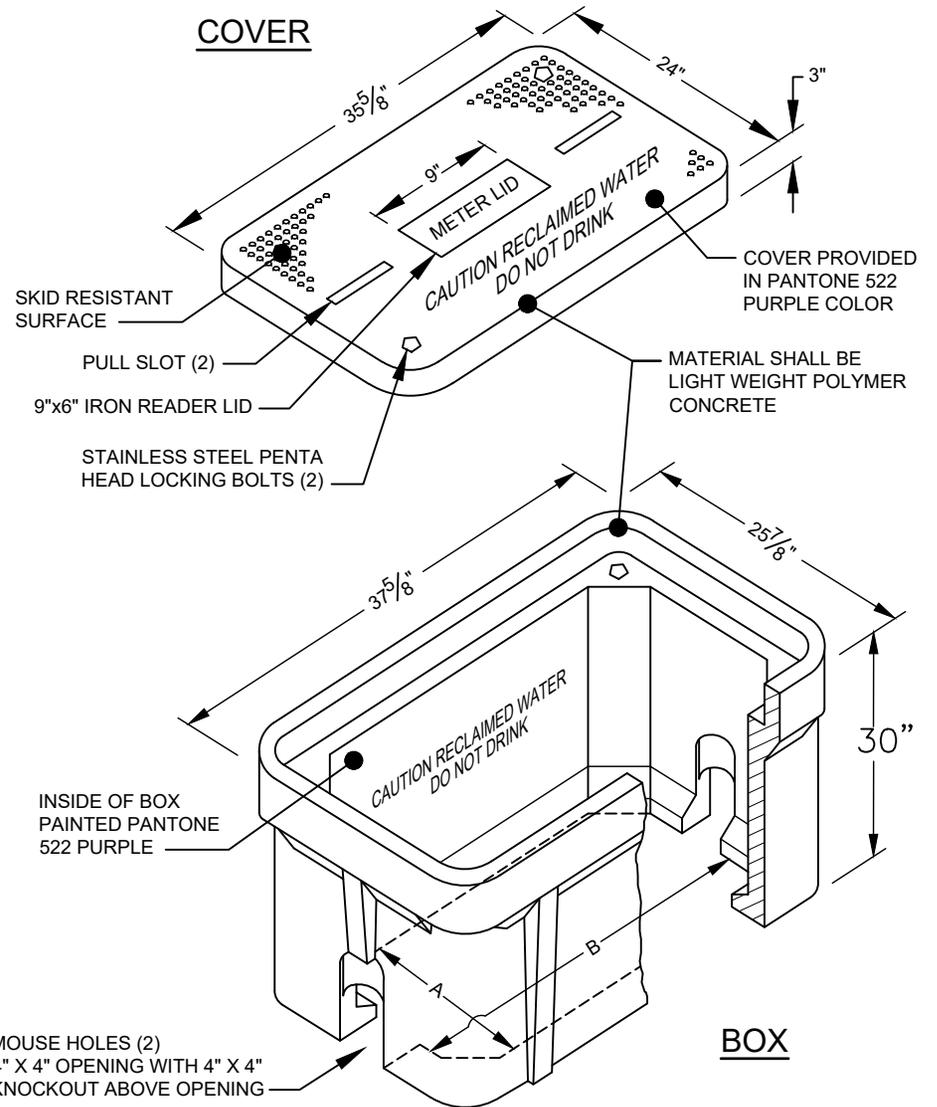

EFFECTIVE: 10/01/16

**STANDARD 1 1/2" & 2" RECLAIMED WATER METER
INSTALLATION & VAULT**

TOWN OF PITTSBORO

STANDARD CONSTRUCTION
DETAIL

STANDARD NO: RW-06-003