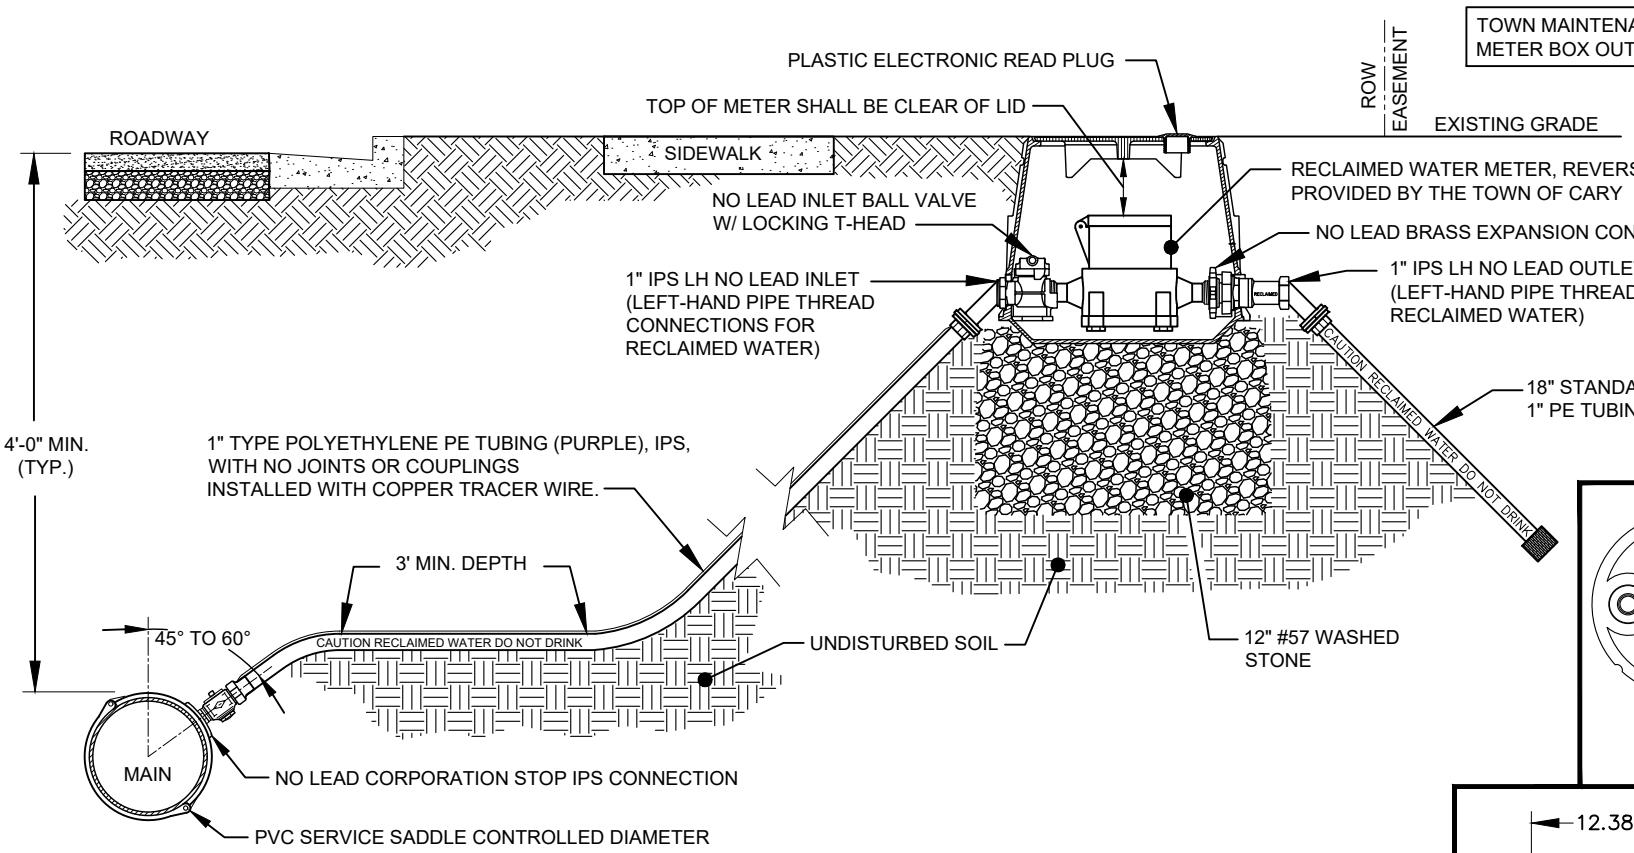

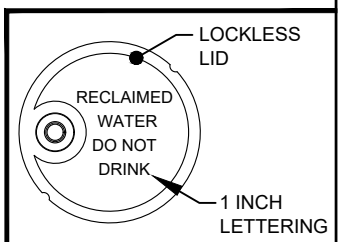

LID TOP VIEW

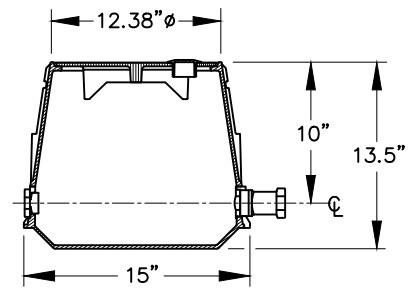

SIDE VIEW

NOTES:

1) WATER METER SHALL NOT BE LOCATED IN AREAS SUBJECT TO VEHICULAR TRAFFIC.
2) ALL METER BOXES AND LIDS SHALL BE APPROVED BY THE TOWN.
3) ALL SERVICE LINES, VALVES AND FITTINGS SHALL COMPLY WITH AWWA C800.
4) THE INTERIOR AND EXTERIOR OF THE BOX AND LID SHALL BE COLORED PANTONE 522 PURPLE.
5) ALL RELOCATIONS OF EXISTING OR PERMITTED RECLAIMED WATER INFRASTRUCTURE INCLUDING SERVICE PIPING AND METER BOXES SHALL BE PERMITTED AND INSPECTED IN CONFORMANCE WITH TOWN POLICIES AND PROCEDURES.
6) BOX AND LID SHALL BE CAST IRON, ASTM A48, CLASS 25.
7) ALL BRASS COMPONENTS SHALL BE 'NO LEAD' BRASS MEETING UNS C89833 AS PER ASTM B584.

PITTSBORO, NORTH CAROLINA 1787

EFFECTIVE: 10/01/16

OPTIONAL 1" RECLAIMED WATER SERVICE & METER BOX INSTALLATION

TOWN OF PITTSBORO

STANDARD CONSTRUCTION DETAIL

STANDARD NO: RW-06-006