


MAIN SIZE	END PIPE SIZE
4" - 8"	2" BLOW-OFF
12" & GREATER	AS APPROVED BY ENGINEERING DEPT.



- NOTES:**
- 1) FOR MAINS THAT ARE TO BE EXTENDED, USE A VALVE EQUAL TO THE MAIN SIZE AS THE BLOW-OFF VALVE AND THEN REDUCE TO THE 2" SDR 21 PVC PIPE.
 - 2) SDR 21 PVC PIPE SHALL BE PROVIDED WITH 200 psi PRESSURE RATING AND CONNECTED WITH BELL/SPIGOT SOLVENT WELD JOINTS.
 - 3) SDR 21 PIPE SHALL BE PROVIDED IN PANTONE 522 PURPLE AND LABELED **"CAUTION RECLAIMED WATER DO NOT DRINK"**.
 - 4) ALL BRASS COMPONENTS SHALL BE 'NO LEAD' BRASS MEETING UNS C89833 AS PER ASTM B584.

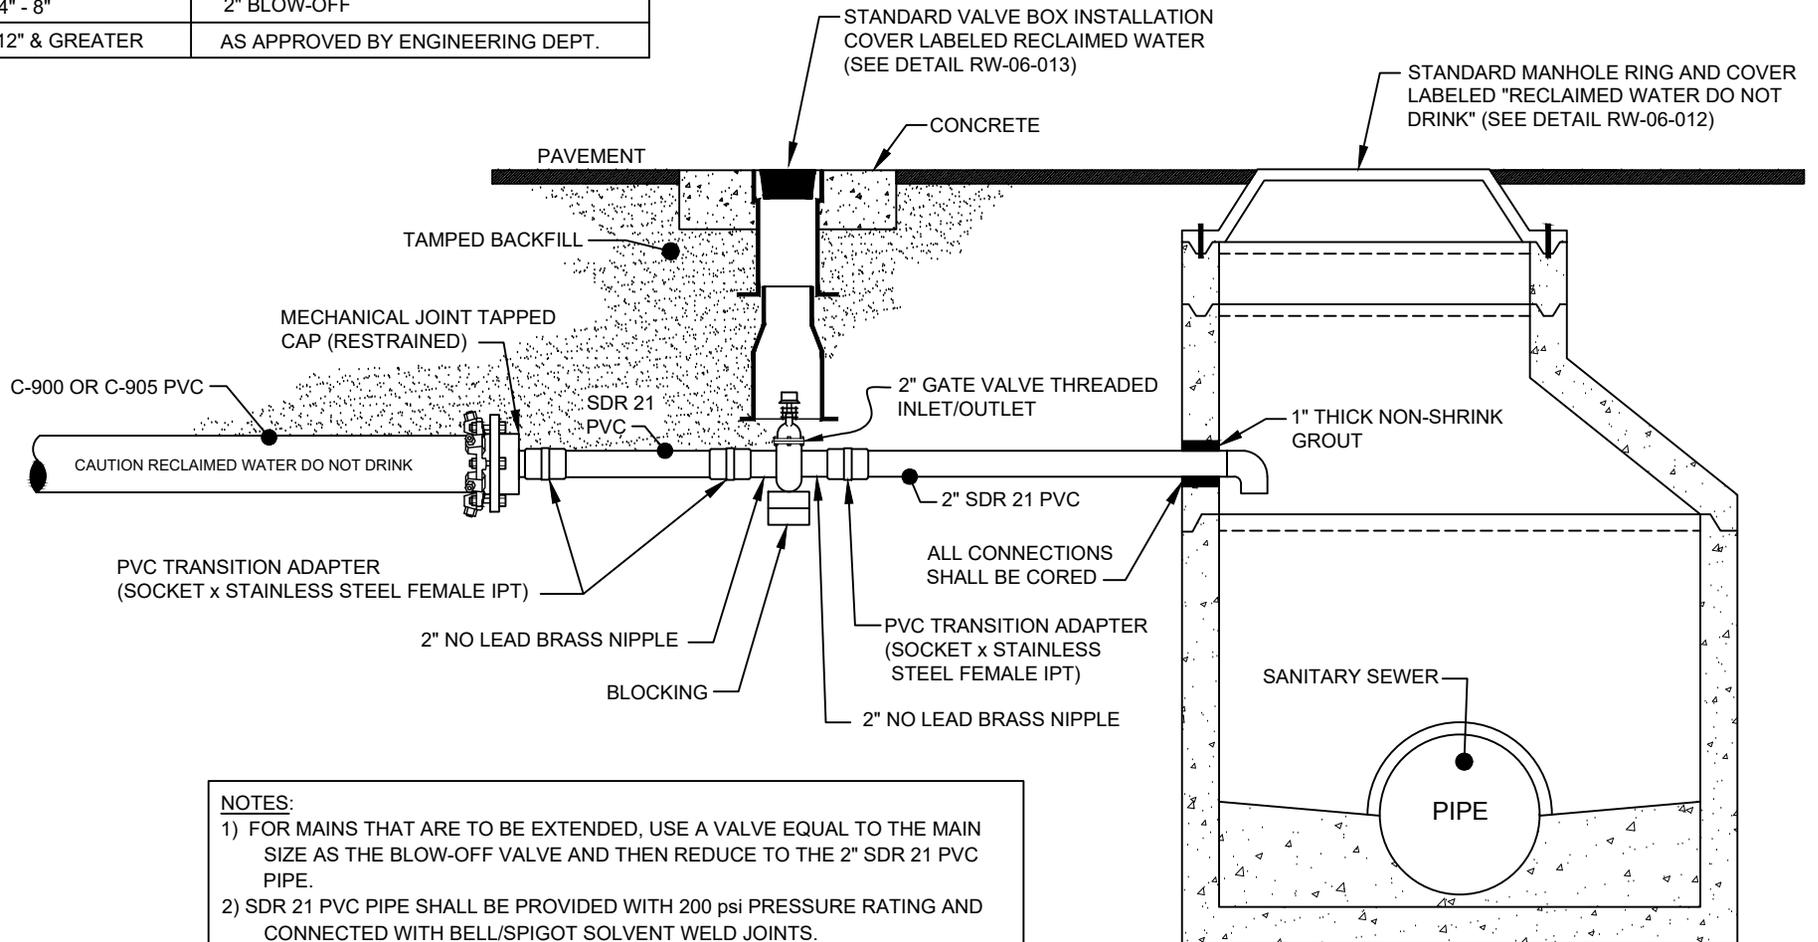

EFFECTIVE: 10/01/16

STANDARD RECLAIMED WATER 2" BLOW-OFF ASSEMBLY

TOWN OF PITTSBORO

STANDARD CONSTRUCTION
DETAIL

STANDARD NO: RW-06-008