


**NOTE:**  
 VALVE OPERATOR EXTENSION SHALL BE INSTALLED IN ALL CASES WHERE THE VALVE OPERATOR IS GREATER THAN 8-FT DEPTH FROM THE SURFACE.

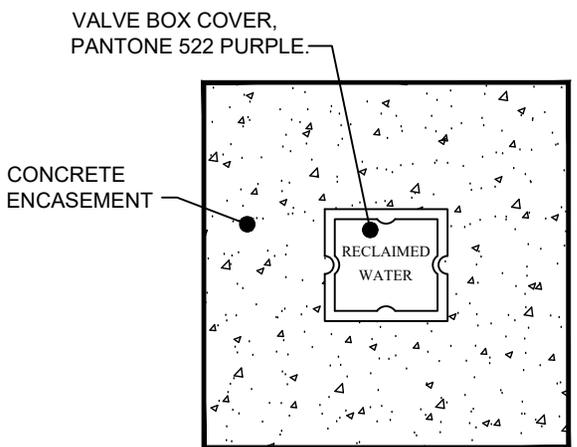

**COVER DETAIL**  
**TOP VIEW**


PVC C-900 OR C-905 WATER MAIN

MECHANICAL JOINT GATE VALVE, RESTRAINED.

CAUTION RECLAIMED WATER DO NOT DRINK

CAUTION RECLAIMED WATER DO NOT DRINK

12" WASHED STONE BEDDING UNDER PIPE & VALVE ASSEMBLY

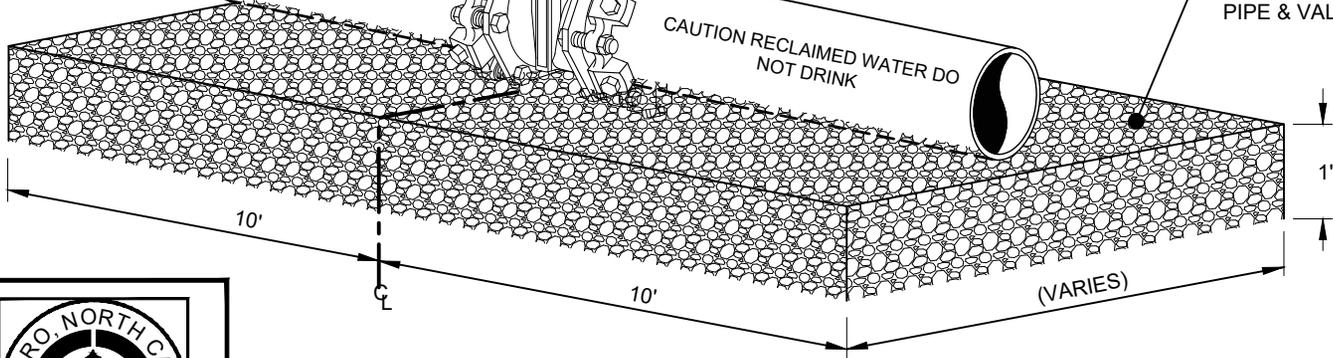

EFFECTIVE: 10/01/16

**RECLAIMED WATER GATE VALVE ASSEMBLY**

**TOWN OF PITTSBORO**  
 STANDARD CONSTRUCTION  
 DETAIL  
 STANDARD NO: RW-06-014