

**SIDEWALK ACCESS RAMPS
GENERAL NOTES**

1. NORTH CAROLINA GENERAL STATUTE 136-44.14 REQUIRES THAT ALL STREET CURBS BEING CONSTRUCTED OR RECONSTRUCTED FOR MAINTENANCE PROCEDURES, TRAFFIC OPERATIONS, REPAIRS, CORRECTIONS OF UTILITIES OR ALTERED FOR ANY REASON AFTER SEPTEMBER 1, 1973 SHALL PROVIDE SIDEWALK ACCESS RAMPS FOR THE PHYSICALLY HANDICAPPED AT ALL INTERSECTIONS WHERE BOTH CURBS AND GUTTER AND SIDEWALKS ARE PROVIDED AND AT OTHER POINTS OF PEDESTRIAN FLOW. IN ADDITION, SECTION 228 OF THE 1973 FEDERAL AID HIGHWAY SAFETY ACT REQUIRES PROVISION OF DEPRESSED CURBS ON ANY CURB CONSTRUCTED AFTER JULY 1, 1976 WHETHER A SIDEWALK IS PROPOSED INITIALLY OR IS PLANNED FOR A FUTURE DATE. THE AMERICANS WITH DISABILITIES ACT (ADA) OF 1990 EXTENDS TO INDIVIDUALS WITH DISABILITIES COMPREHENSIVE CIVIL RIGHTS PROTECTION SIMILAR TO THOSE PROVIDED TO PERSONS ON THE BASIS OF RACE, SEX, NATIONAL ORIGIN AND RELIGION UNDER THE CIVIL RIGHTS ACT OF 1964. THE ADOPTED SIDEWALK ACCESS RAMPS HAVE BEEN DESIGNED TO COMPLY WITH TITLE III OF THE ADA, THAT BECAME EFFECTIVE ON JANUARY 26, 1992 AND AS AMENDED, THE ADA REQUIREMENTS FOR DETECTABLE WARNINGS WERE SUSPENDED EFFECTIVE MAY 12, 1994.

2. SIDEWALK ACCESS RAMPS SHALL BE PROVIDED AT LOCATIONS AS SHOWN ON THE PLANS OR AS DIRECTED BY THE ENGINEER. SIDEWALK ACCESS RAMPS SHALL BE LOCATED AS INDICATED IN THE DETAIL HOWEVER, THE LOCATION MAY BE ADJUSTED AS DIRECTED BY THE ENGINEER WHERE EXISTING LIGHT POLES, FIRE HYDRANTS, DROP INLETS, ETC. AFFECT PLACEMENT. AT ALL LOCATIONS, NOT LESS THAN 2 FEET OF FULL HEIGHT CURB SHALL BE PLACED BETWEEN DOUBLE RAMPS. DOUBLE WHEELCHAIR RAMPS ARE TO BE INSTALLED AT ALL PUBLIC STREET INTERSECTIONS WHERE SIDEWALK IS REQUIRED. WHEN SIDEWALK IS NOT REQUIRED, CURB IS TO BE DEPRESSED AT ALL RAMP LOCATIONS.

3. THE WALKING SURFACE SHALL BE SLIP RESISTANT. COLORS FOR THE RAMP SHALL BE DARK CHARCOAL GRAY FOR CONTRAST WITH LIGHT PATHWAY COLORS AND LIGHT CONCRETE GRAY FOR CONTRAST WITH DARK PATHWAY COLORS AND SHALL BE AN INTEGRAL PART OF THE CONSTRUCTION MATERIAL. IRON OXIDE PIGMENT SHALL BE USED AT THE RATE OF 25 LBS. OF PIGMENT PER CU. YARD OF CONCRETE.


4. NO SLOPE ON THE SIDEWALK ACCESS RAMP SHALL EXCEED 17'1" (12:1) IN RELATIONSHIP TO THE GRADE OF THE STREET.

5. IN NO CASE SHALL THE WIDTH OF THE SIDEWALK ACCESS RAMP BE LESS THAN 40" (3'-4") HOWEVER, RAMP MAY EXCEED 40".

6. USE CLASS A (3000 PSI) CONCRETE WITH A SIDEWALK FINISH IN ORDER TO OBTAIN A ROUGH NONSKID SURFACE.


7. A 1/2" EXPANSION JOINT WILL BE REQUIRED WHERE THE CONCRETE SIDEWALK ACCESS RAMP JOINS THE CURB AND AS SHOWN ON THE STANDARD DRAWING.

8. SINGLE OR DIAGONAL RAMPS ARE NOT PERMISSIBLE FOR NEW CONSTRUCTION.

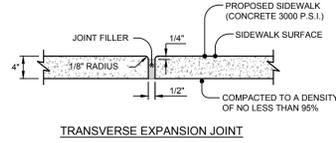


TRANSVERSE EXPANSION JOINT
NOTES:
1. TRANSVERSE EXPANSION JOINTS TO BE A MAXIMUM OF 25' APART.
2. ALL CONCRETE TO BE FINISHED WITH CURING COMPOUND.


STANDARD CONCRETE SIDEWALK
NTS

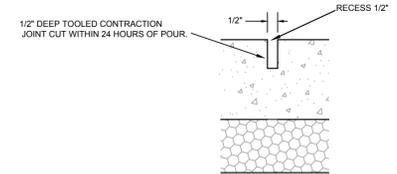

CONTRACTION JOINT
NTS

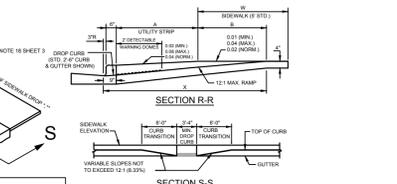


STANDARD WHEELCHAIR RAMP
NTS

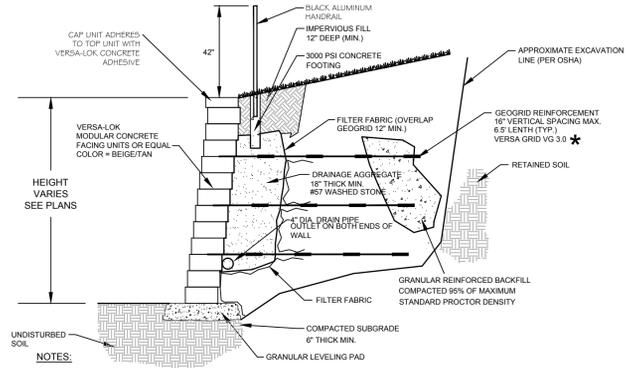


NOTES:
1. FACTOR OF SAFETY FOR SLIDING: 1.5
2. FACTOR OF SAFETY FOR OVERTURNING: 2.0
3. FOLLOW APPLICABLE PROVISIONS OF SPECIFICATIONS FOR THE PROPER INSTALLATION OF VERSA-LOK RETAINING WALL SYSTEM AND GEGRID.
4. ALLOWABLE SOIL BEARING PRESSURE: 3000 PSF
5. ALL FILL OR BACKFILL SHALL BE FREE FROM ROOTS, TRASH, WOOD SCRAPS AND OTHER EXTRANEIOUS MATERIAL. PLACE FILL IN LIFTS OF NO MORE THAN 8 INCHES AND COMPACT EACH LIFT TO 95% STANDARD PROCTOR DENSITY AT OPTIMUM MOISTURE CONTENT.
6. PROVIDE BRACING AGAINST WALL AS REQUIRED TO PREVENT DAMAGE DURING COMPACTION OF FILL. ONLY HAND-OPERATED COMPACTION EQUIPMENT TO BE USED WITHIN 3 FEET OF WALL.
7. MINIMUM 18" DRAINAGE FILL BEHIND WALL.
8. PROVIDE LATERAL DRAINAGE.
9. WEIGHT OF SOIL = 120 PCF
10. PROVIDE 12" HIGH HAND RAILING ALONG THE TOP OF WALLS WITH A DIFFERENCE IN ELEVATION OF 36" AND GREATER. RAILING AND CONNECTIONS SHALL BE ENGINEERED AND FABRICATED TO MEET THE NC BUILDING CODE REQUIREMENTS.
11. CONTRACTOR TO PROVIDE SHOP DRAWING FOR RAILING AND FOOTING.
12. WALL DESIGN TO BE CERTIFIED BY GEOTECHNICAL ENGINEER PER EXISTING SOIL CONDITIONS PRIOR TO CONSTRUCTION.


TYPICAL SECTION-SEGMENTAL BLOCK WALL
NTS

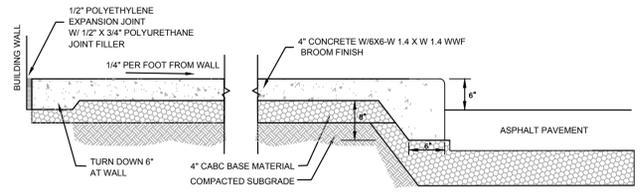


STANDARD SIDEWALK TURNDOWN DETAIL
NTS

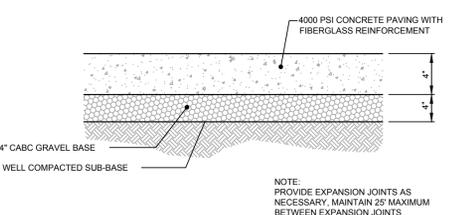


CONCRETE SLAB FOR SOLID WASTE ROLLOUT CONTAINERS
NTS




LAP JOINT DETAIL (AT ENTRANCE)
NTS

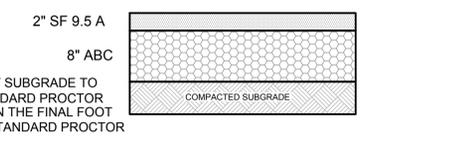


TYPICAL PARKING STALL PAVEMENT
SECTION
NTS

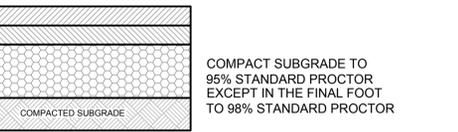


TYPICAL DRIVEWAY/ROAD PAVEMENT
SECTION
NTS

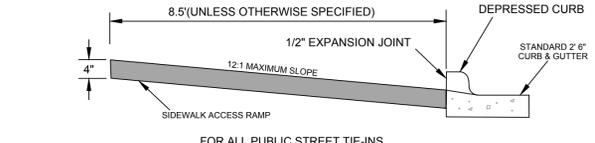


SECTION "A-A"
NTS

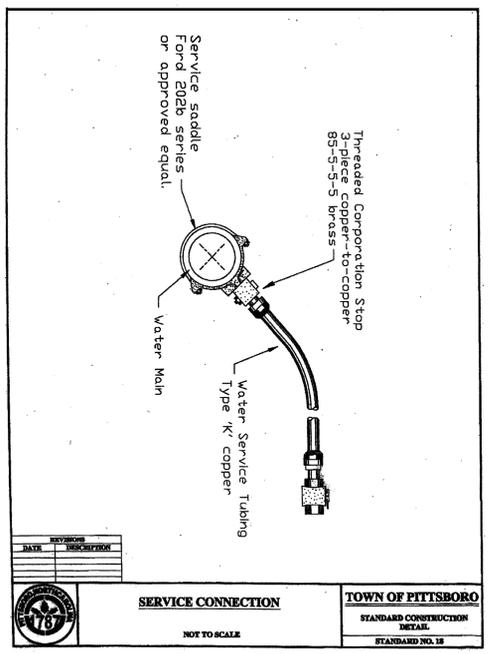


SERVICE CONNECTION
TOWN OF PITTSBORO
STANDARD CONSTRUCTION
SECTION
STANDARD NO. 18

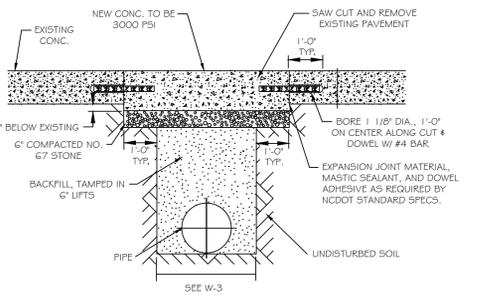


STANDARD CONCRETE PAVEMENT PATCH DETAIL
NTS

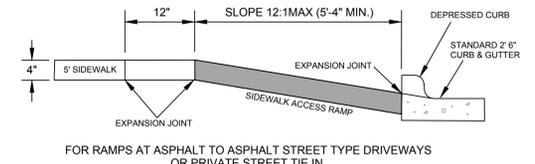


SECTION "B-B"
NTS

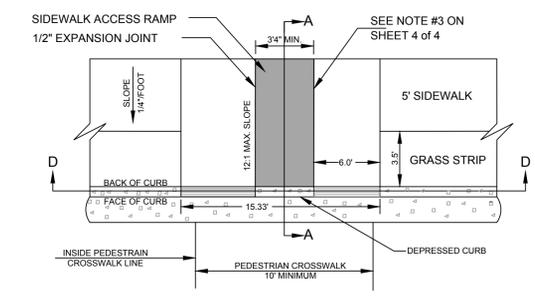

PLAY VIEW SIDEWALK ACCESS RAMP
NTS

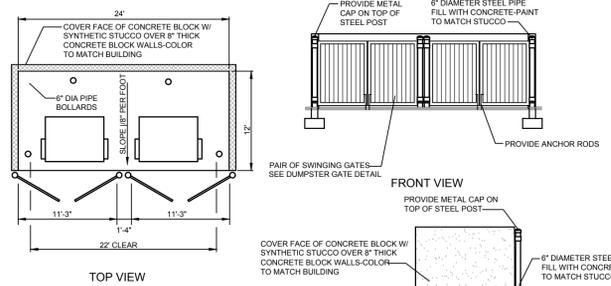

DOUBLE CONTAINER DUMPSTER ENCLOSURE
NTS

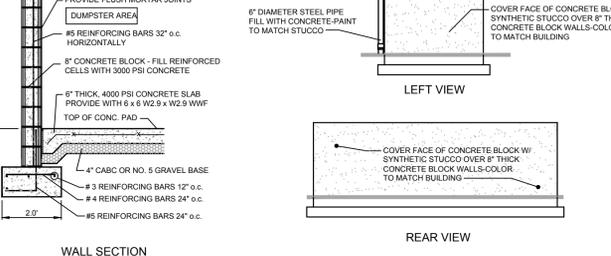

DOUBLE CONTAINER DUMPSTER ENCLOSURE
NTS



FINAL DESIGN
NOT RELEASED
FOR CONSTRUCTION

NO.	REVISIONS	DATE
1	REVISED PER TOWN COMMENTS	7/22/16
2	REVISED PER TOWN COMMENTS	8/23/16

CE GROUP
301 GLENWOOD AVE. 220
RALEIGH, NC 27603
PHONE: 919-367-8790
FAX: 919-322-0032
www.cegroupinc.com
License # C-1739



SITE DEVELOPMENT PLANS FOR LOT 9 US 64 EAST BUSINESS PARK SITE DETAILS CHATHAM COUNTY, NC

Date: APRIL, 2016
Scale: -
Drawn: CPM
Checked: MPA
Project No: 127-198
Computer Dwg. Name: 127-198_Sht-09-10 Site Details