



PLAN VIEW

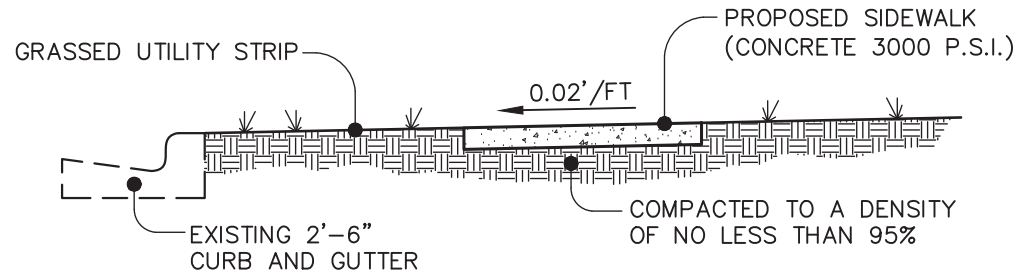

TYPICAL SECTION

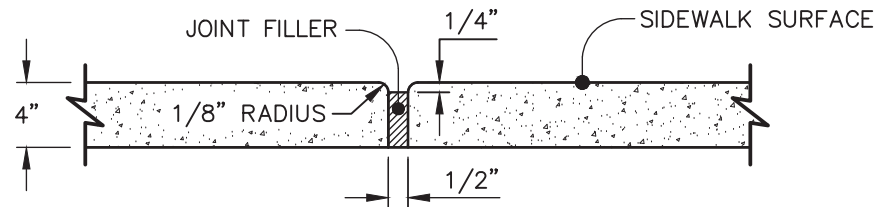

TRANSVERSE EXPANSION JOINT

NOTES

1. MINIMUM 8' SIDEWALK WIDTH FOR MIXED-USE DEVELOPMENT, MINIMUM 5' FOR ALL OTHER DEVELOPMENT
2. TRANSVERSE EXPANSION JOINTS TO BE A MAXIMUM OF 5'
3. ALL CONCRETE TO BE FINISHED PER STANDARD SPECIFICATIONS
4. A 6 INCH DEPTH IS REQUIRED AT LOCATIONS OF DRIVEWAY CROSSINGS, AT STREET INTERSECTIONS (ALONG THE LENGTH OF RADIUS CURB RETURNS), AND IN THE HANDICAP RAMPS



EFFECTIVE: 12/13/21

STANDARD CONCRETE SIDEWALK

TOWN OF PITTSBORO

STANDARD CONSTRUCTION
DETAIL

STANDARD NO: ST-08-009