



PROFILE VIEW

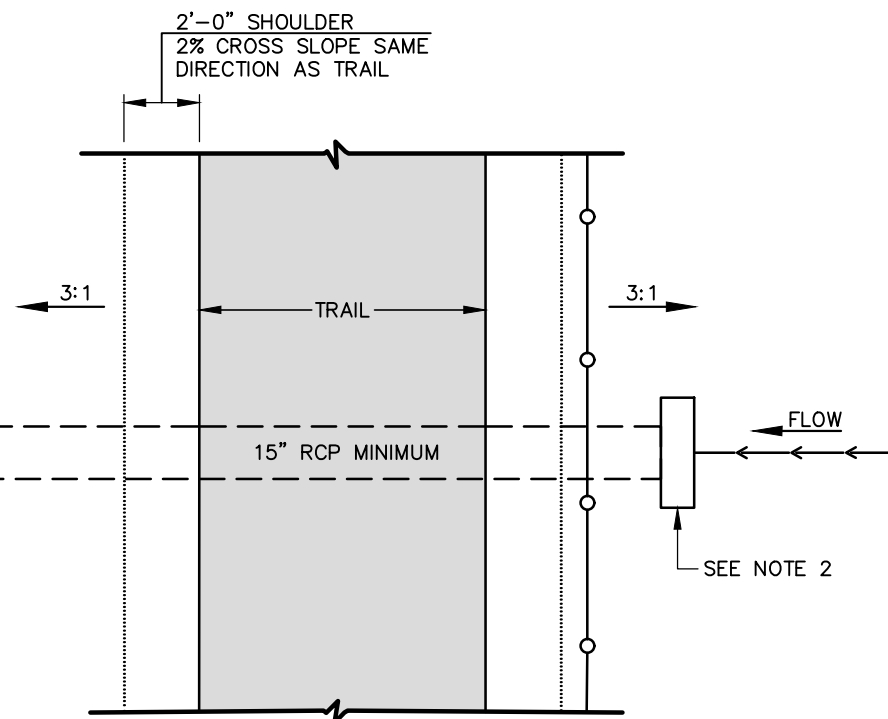

PLAN VIEW

- NOTES**
1. PIPE SHALL BE SIZED BY ENGINEER WITH CALCULATIONS INCLUDED IN PLANS, BUT SHALL BE MINIMUM CLASS III REINFORCED CONCRETE PIPE, 15 INCH DIAMETER
 2. HEADWALLS, ENDWALLS, OR FLARED END SECTIONS SHALL BE INSTALLED AT ENDS OF PIPE
 3. BACKFILL PIPE TRENCH TO 95% COMPACTION
 4. 2 FT GRASSED SHOULDERS AT MAXIMUM 2% CROSS SLOPE SHALL BE MAINTAINED
 5. MAXIMUM 3:1 SIDE SLOPES TO BE MAINTAINED BEYOND SHOULDERS, UNLESS OTHERWISE APPROVED BY THE TOWN

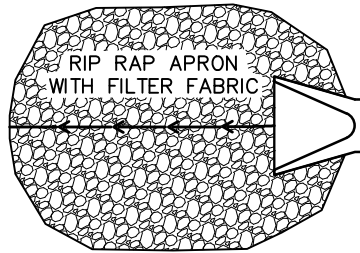

GREENWAY CULVERT



EFFECTIVE: X/XX/21

TOWN OF PITTSBORO
 STANDARD CONSTRUCTION
 DETAIL
 STANDARD NO: GR-09-007