


TYPE A – SINGLE SERVICE

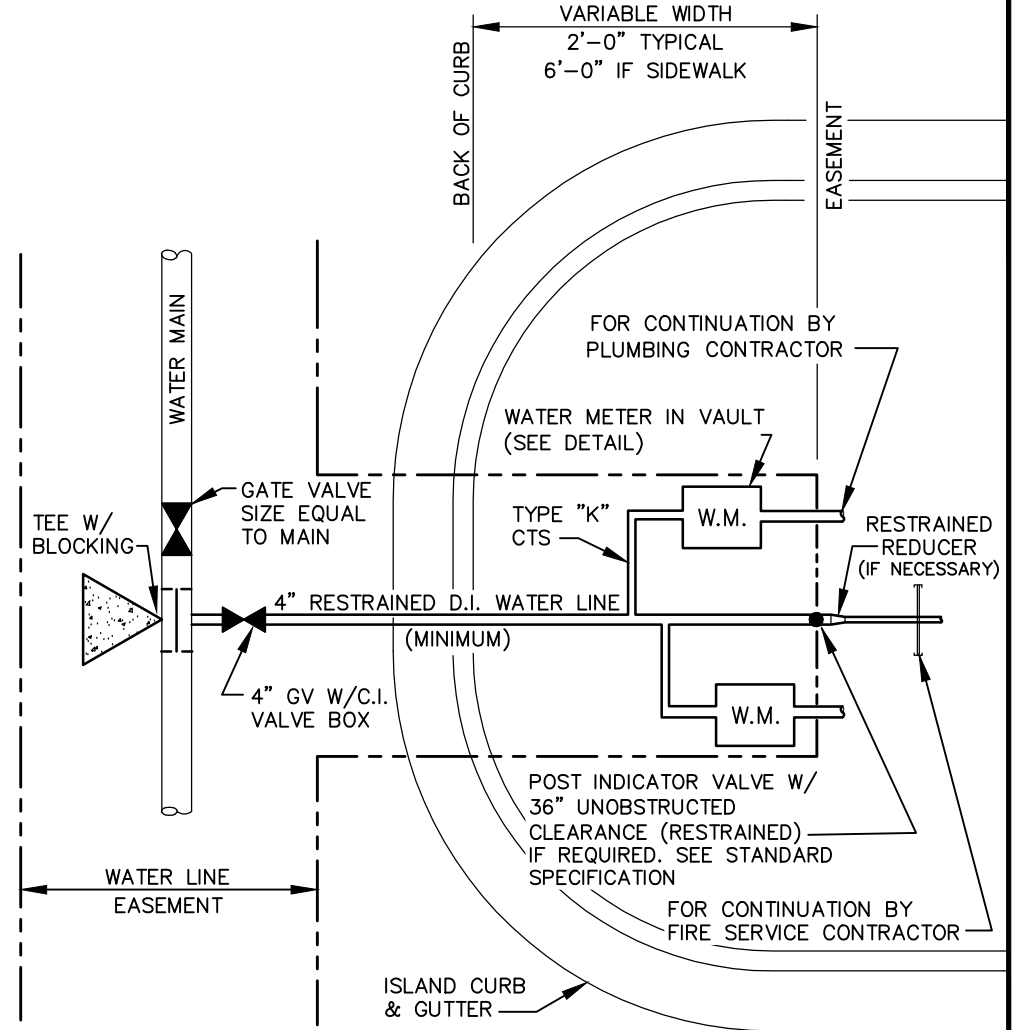

TYPE B – DOUBLE SERVICE

NOTES:
 1. SYSTEM TO BE MAINTAINED BY THE OWNER PAST THE EASEMENT LINE.
 2. MARKING TAPE SHALL BE INSTALLED FOR ALL SERVICE CONNECTIONS FROM THE MAIN LINE TO THE METER FOR ALL NEW CONSTRUCTION OR RETROFIT INSTALLATIONS USING OPEN TRENCH METHODS.

STANDARD COMBINED FIRE & DOMESTIC WATER SERVICE

EFFECTIVE: X/XX/22