


NOTES:

1. VALVE OPERATOR EXTENSION SHALL BE INSTALLED IN ALL CASES WHERE THE VALVE OPERATOR IS GREATER THAN 6-FT DEPTH FROM THE SURFACE.
2. SPUR GEAR OPERATOR REQUIRED FOR GATE VALVES \geq 18 INCHES.

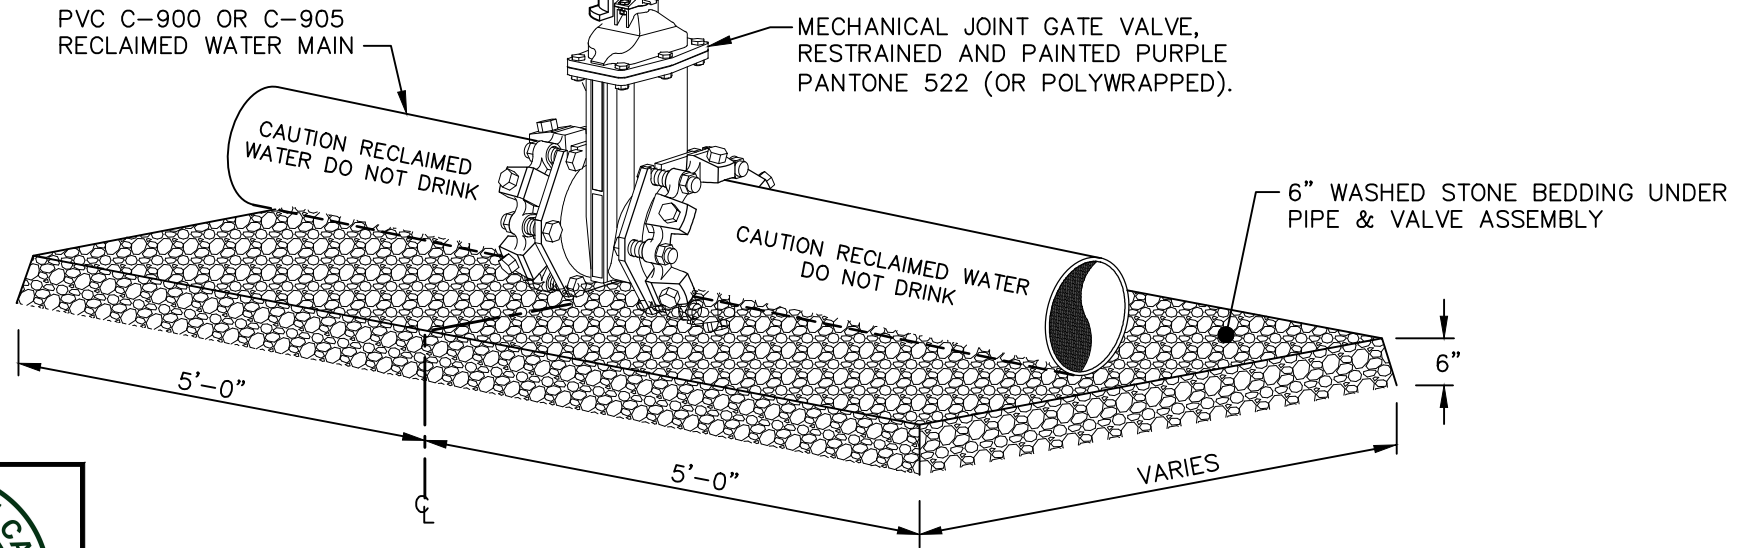

**RESILIENT WEDGE GATE VALVE ASSEMBLY FOR RECLAIMED WATER
(VERTICAL INSTALLATIONS)**

TOWN OF PITTSBORO
STANDARD CONSTRUCTION
DETAIL
STANDARD NO: RW-06-015