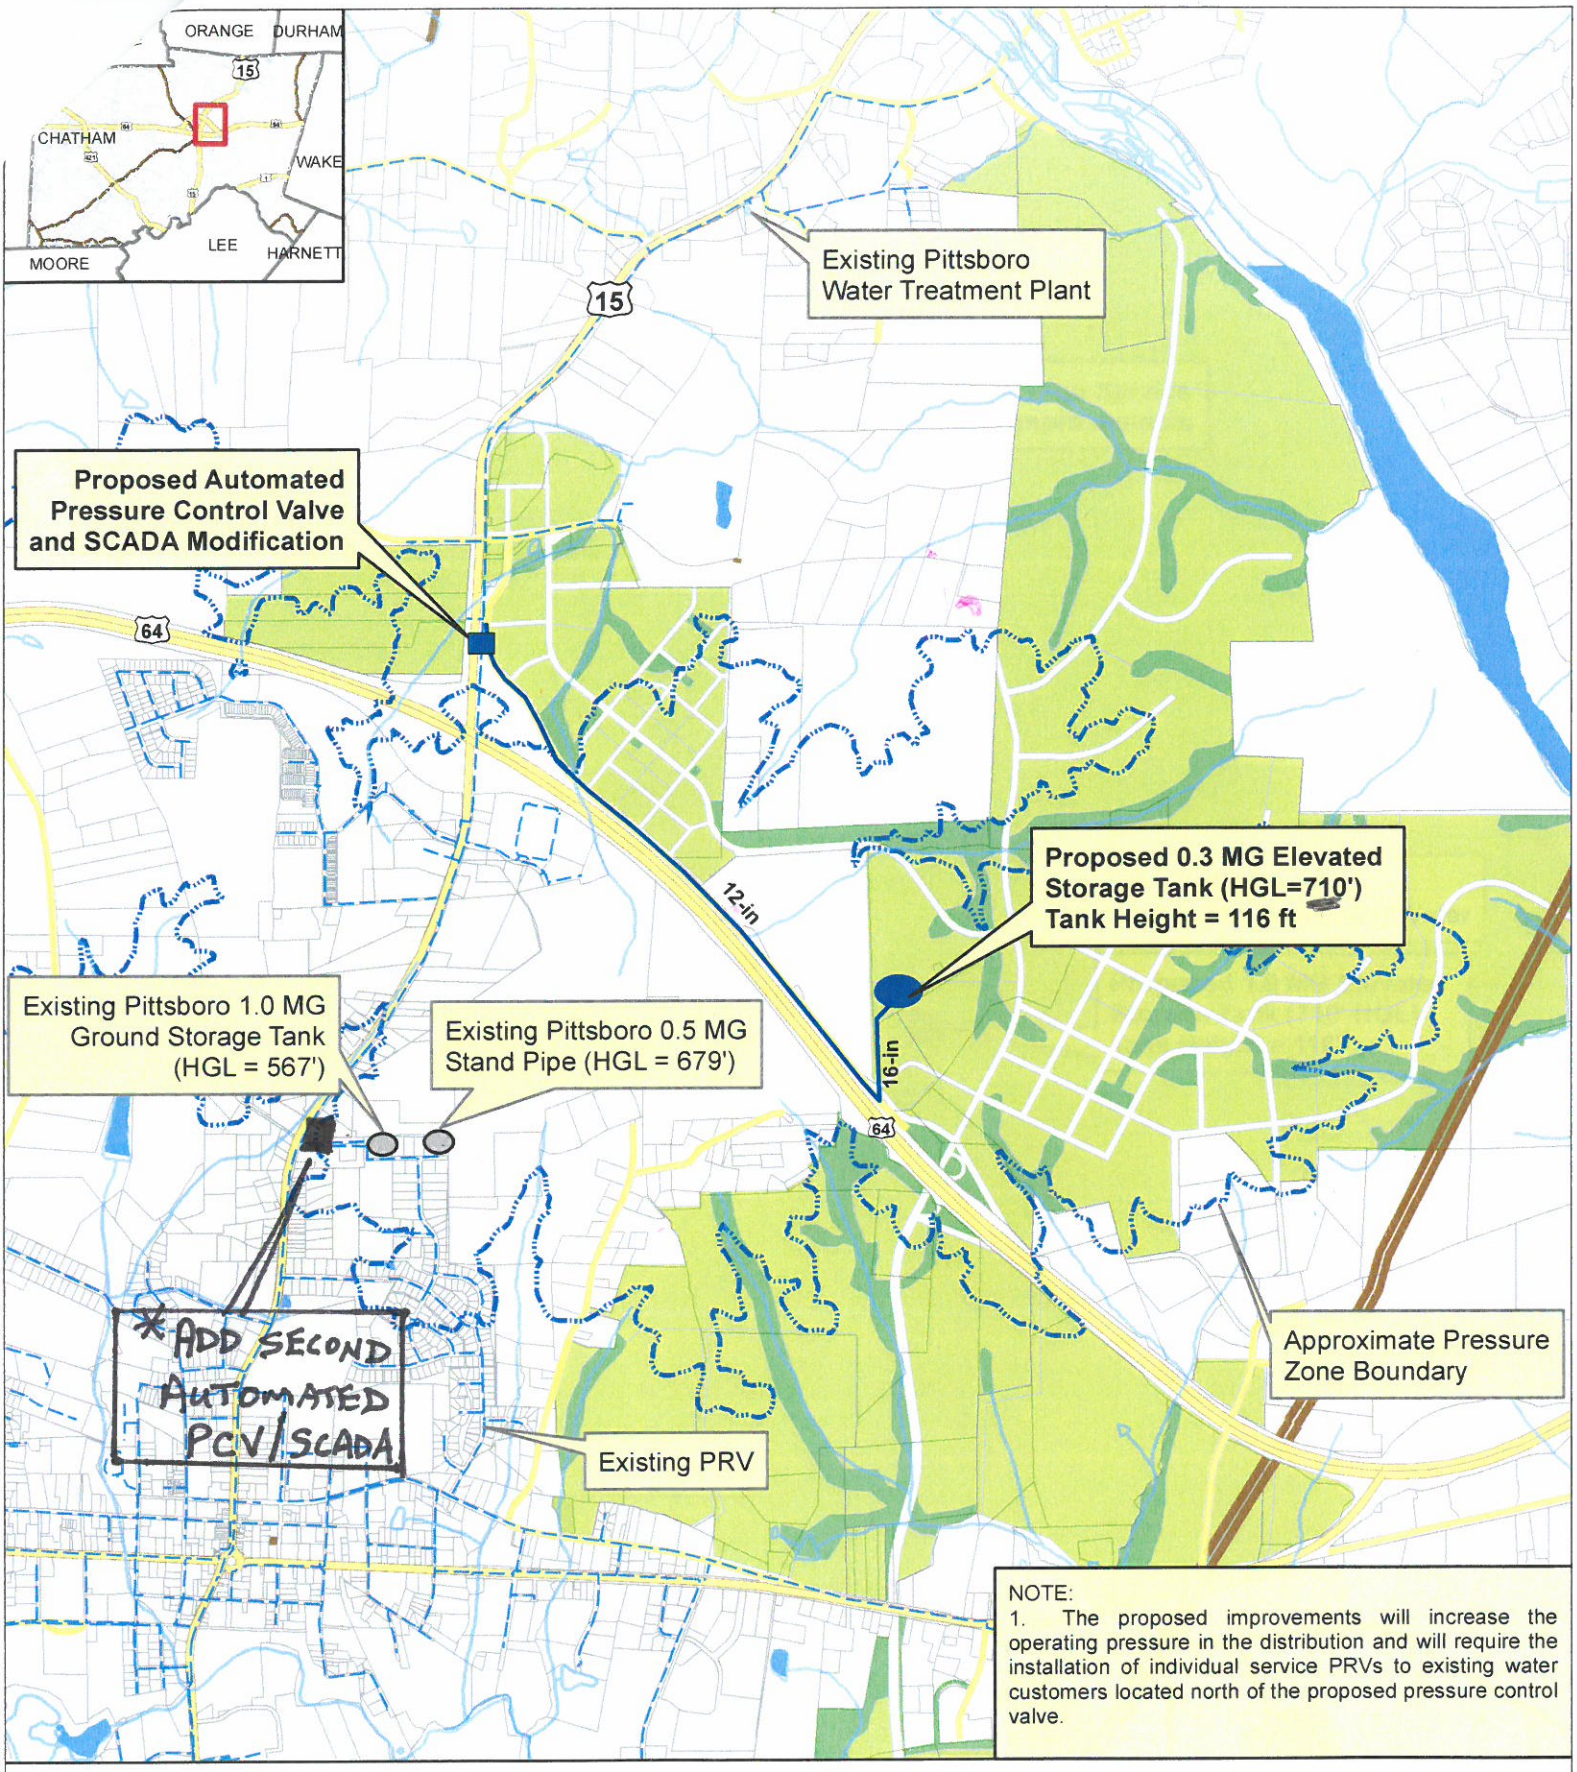

NOTE:
1. The proposed improvements will increase the operating pressure in the distribution and will require the installation of individual service PRVs to existing water customers located north of the proposed pressure control valve.

* STAFF RECOMMENDATION

N
NC NAD 83
(US FEET)

Chatham Park

Water System Improvements - PHASE I

Chatham County, NC

0 1,200 2,400 4,800 Feet

McKIM&CREED

4/2/2015