



Town of Pittsboro Water

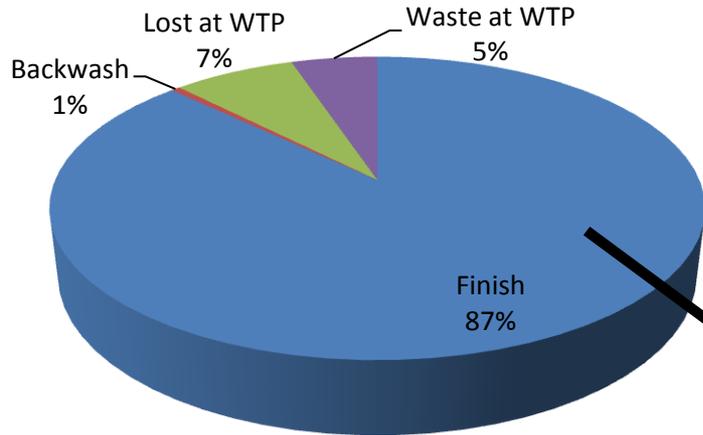

Raw Water = 212 Million Gallons

■ Finish ■ Backwash ■ Lost at WTP ■ Waste at WTP

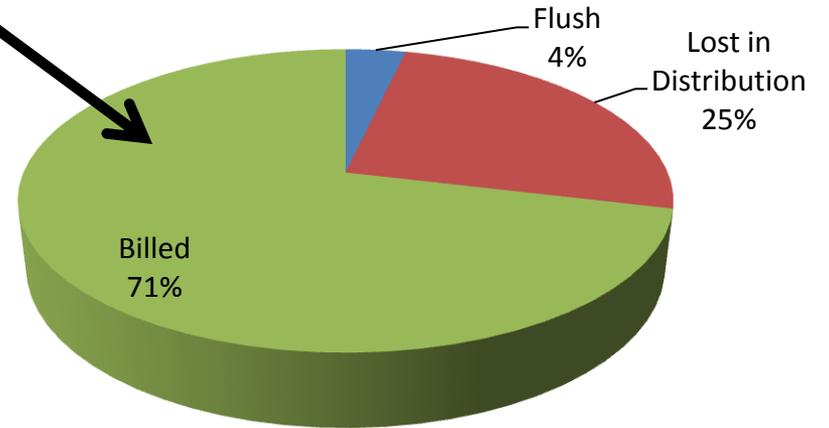


Finished Water = 185 Million Gallons

■ Flush ■ Lost in Distribution ■ Billed

Town of Pittsboro Water

212 Million Gallons input from Haw River

Yields 185 Million Gallons treated water

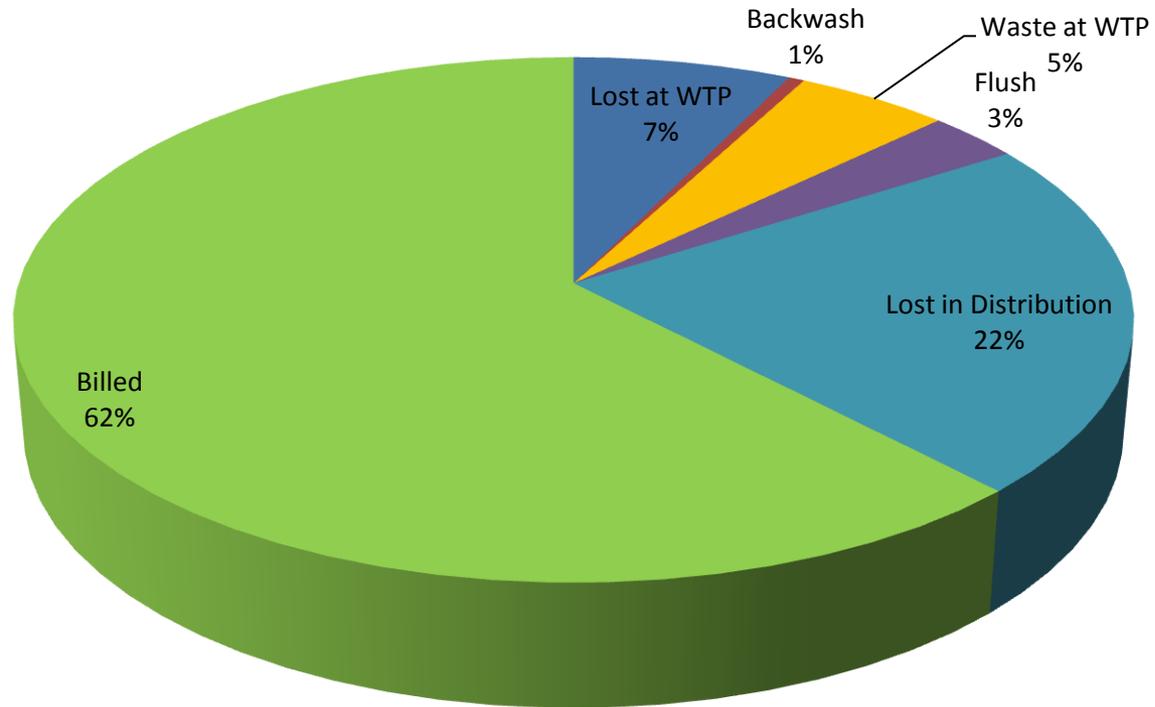

■ Lost at WTP ■ Backwash ■ Waste at WTP ■ Flush ■ Lost in Distribution ■ Billed

Pittsboro Water Treatment System

